



European Network of
Transmission System Operators
for Electricity

POWER SCHEDULE PROFILE SPECIFICATION

2023-05-10

APPROVED DOCUMENT
VERSION 2.2

1 Copyright notice:

2 **Copyright © ENTSO-E. All Rights Reserved.**

3 This document and its whole translations may be copied and furnished to others, and derivative
4 works that comment on or otherwise explain it or assist in its implementation may be prepared,
5 copied, published and distributed, in whole or in part, without restriction of any kind, provided
6 that the above copyright notice and this paragraph are included on all such copies and
7 derivative works. However, this document itself may not be modified in any way, except for
8 literal and whole translation into languages other than English and under all circumstances, the
9 copyright notice or references to ENTSO-E may not be removed.

10 This document and the information contained herein is provided on an "as is" basis.

11 **ENTSO-E DISCLAIMS ALL WARRANTIES, EXPRESS OR IMPLIED, INCLUDING BUT NOT**
12 **LIMITED TO ANY WARRANTY THAT THE USE OF THE INFORMATION HEREIN WILL NOT**
13 **INFRINGE ANY RIGHTS OR ANY IMPLIED WARRANTIES OF MERCHANTABILITY OR**
14 **FITNESS FOR A PARTICULAR PURPOSE.**

15 **This document is maintained by the ENTSO-E CIM WG. Comments or remarks are to be**
16 **provided at cim@entsoe.eu**

17 **NOTE CONCERNING WORDING USED IN THIS DOCUMENT**

18 The force of the following words is modified by the requirement level of the document in which
19 they are used.

- 20 • SHALL: This word, or the terms "REQUIRED" or "MUST", means that the definition is an
21 absolute requirement of the specification.
- 22 • SHALL NOT: This phrase, or the phrase "MUST NOT", means that the definition is an
23 absolute prohibition of the specification.
- 24 • SHOULD: This word, or the adjective "RECOMMENDED", means that there may exist valid
25 reasons in particular circumstances to ignore a particular item, but the full implications must
26 be understood and carefully weighed before choosing a different course.
- 27 • SHOULD NOT: This phrase, or the phrase "NOT RECOMMENDED", means that there may
28 exist valid reasons in particular circumstances when the particular behaviour is acceptable
29 or even useful, but the full implications should be understood and the case carefully weighed
30 before implementing any behaviour described with this label.
- 31 • MAY: This word, or the adjective "OPTIONAL", means that an item is truly optional.

32

33

Revision History

Version	Release	Date	Paragraph	Comments
2	2	2023-03-24		For review.
2	2	2023-05-10		ICTC approved.

34	CONTENTS		
35	Copyright notice:.....		2
36	Revision History.....		3
37	CONTENTS		4
38	1 Introduction		6
39	2 Application profile specification		6
40	2.1 Version information		6
41	2.2 Constraints naming convention		6
42	2.3 Profile constraints		7
43	2.4 Metadata.....		9
44	2.4.1 Constraints		9
45	2.4.2 Reference metadata		9
46	3 Detailed Profile Specification		9
47	3.1 General.....		9
48	3.2 (abstract,NC) AreaDispatchableUnit root class.....		10
49	3.3 (abstract,NC) BaseIrregularTimeSeries		10
50	3.4 (abstract,NC) BaseTimeSeries.....		11
51	3.5 (abstract,NC) BiddingZone root class		11
52	3.6 (abstract,NC) BiddingZoneBorder root class		11
53	3.7 (abstract,NC) DCTieCorridor root class		11
54	3.8 (abstract) EnergyConnection root class.....		11
55	3.9 (abstract,NC) EnergyTypeReference root class.....		11
56	3.10 (abstract) EquivalentInjection root class.....		11
57	3.11 (abstract) GeneratingUnit root class.....		12
58	3.12 (abstract) HydroPump root class		12
59	3.13 (abstract) IdentifiedObject root class		12
60	3.14 (NC) MustRunSchedule		12
61	3.15 (NC) MustRunTimePoint root class		13
62	3.16 (abstract) PowerElectronicsUnit root class		13
63	3.17 (abstract,NC) PowerRemedialAction root class		13
64	3.18 (NC) PowerSchedule		13
65	3.19 (NC) PowerTimePoint root class		14
66	3.20 (abstract,NC) SchedulingArea root class.....		15
67	3.21 ActivePower datatype		15
68	3.22 ReactivePower datatype		15
69	3.23 (NC) BaseTimeSeriesKind enumeration		16
70	3.24 (NC) TimeSeriesInterpolationKind enumeration.....		16
71	3.25 UnitSymbol enumeration		16
72	3.26 UnitMultiplier enumeration		17
73	3.27 Boolean primitive		18
74	3.28 DateTime primitive.....		18
75	3.29 Decimal primitive		18
76	3.30 Float primitive		18
77	3.31 Integer primitive.....		18

78	3.32	String primitive.....	18
79	Annex A (informative): Sample data		19
80	A.1	General.....	19
81	A.2	Sample instance data.....	19
82			
83	List of figures		
84	Figure 1 – Class diagram PowerScheduleProfile::PowerScheduleProfile		10
85			
86	List of tables		
87	Table 1 – Attributes of PowerScheduleProfile::BaseIrregularTimeSeries		10
88	Table 2 – Attributes of PowerScheduleProfile::BaseTimeSeries		11
89	Table 3 – Attributes of PowerScheduleProfile::IdentifiedObject		12
90	Table 4 – Attributes of PowerScheduleProfile::MustRunSchedule		12
91	Table 5 – Association ends of PowerScheduleProfile::MustRunSchedule with other		
92	classes		13
93	Table 6 – Attributes of PowerScheduleProfile::MustRunTimePoint		13
94	Table 7 – Association ends of PowerScheduleProfile::MustRunTimePoint with other		
95	classes		13
96	Table 8 – Attributes of PowerScheduleProfile::PowerSchedule		14
97	Table 9 – Association ends of PowerScheduleProfile::PowerSchedule with other		
98	classes		14
99	Table 10 – Attributes of PowerScheduleProfile::PowerTimePoint		15
100	Table 11 – Association ends of PowerScheduleProfile::PowerTimePoint with other		
101	classes		15
102	Table 12 – Attributes of PowerScheduleProfile::ActivePower		15
103	Table 13 – Attributes of PowerScheduleProfile::ReactivePower		16
104	Table 14 – Literals of PowerScheduleProfile::BaseTimeSeriesKind		16
105	Table 15 – Literals of PowerScheduleProfile::TimeSeriesInterpolationKind		16
106	Table 16 – Literals of PowerScheduleProfile::UnitSymbol		17
107	Table 17 – Literals of PowerScheduleProfile::UnitMultiplier.....		18
108			

109 1 Introduction

110 The power schedule profile enables exchanging power schedule information and their time
111 points.

112 2 Application profile specification

113 2.1 Version information

114 The content is generated from UML model file CIM100_CGMES31v01_501-
115 20v02_NC22v95_MM10v01.eap.

116 This edition is based on the IEC 61970 UML version 'IEC61970CIM17v40', dated '2020-08-24'.

- 117 - Title: Power schedule vocabulary
- 118 - Keyword: PS
- 119 - Description: This vocabulary is describing the object registry profile.
- 120 - Version IRI: <http://entsoe.eu/ns/CIM/PowerSchedule-EU/2.2>
- 121 - Version info: 2.2.0
- 122 - Prior version:
- 123 - Conforms to: urn:iso:std:iec:61970-600-2:ed-1|urn:iso:std:iec:61970-301:ed-7:amd1|file:///iec61970cim17v40_iec61968cim13v13a_iec62325cim03v17a.eap|urn:iso:std:iec:61970-401:draft:ed-1|urn:iso:std:iec:61970-501:draft:ed-2|file:///CGMES-30v25_501-20v01.eap
- 126
- 127 - Identifier: <urn:uuid:470c9792-7798-4eb6-b7f2-6e18293c5f7b>

128 2.2 Constraints naming convention

129 The naming of the rules shall not be used for machine processing. The rule names are just a
130 string. The naming convention of the constraints is as follows.

131 "{rule.Type}:{rule.Standard}:{rule.Profile}:{rule.Property}:{rule.Name}"

132 where

133 rule.Type: C – for constraint; R – for requirement

134 rule.Standard: the number of the standard e.g. 301 for 61970-301, 456 for 61970-456, 13 for
135 61968-13. 61970-600 specific constraints refer to 600 although they are related to one or
136 combination of the 61970-450 series profiles. For NC profiles, NC is used.

137 rule.Profile: the abbreviation of the profile, e.g. TP for Topology profile. If set to "ALL" the
138 constraint is applicable to all IEC 61970-600 profiles.

139 rule.Property: for UML classes, the name of the class, for attributes and associations, the name
140 of the class and attribute or association end, e.g. EnergyConsumer, IdentifiedObject.name, etc.
141 If set to "NA" the property is not applicable to a specific UML element.

142 rule.Name: the name of the rule. It is unique for the same property.

143 Example: C:600:ALL:IdentifiedObject.name:stringLength

144 2.3 Profile constraints

145 This clause defines requirements and constraints that shall be fulfilled by applications that
146 conform to this document.

147 This document is the master for rules and constraints tagged "NC". For the sake of self-
148 containment, the list below also includes a copy of the relevant rules from IEC 61970-452,
149 tagged "452".

- 150 • C:452:ALL:NA:datatypes

151 According to 61970-501, datatypes are not exchanged in the instance data. The
152 UnitMultiplier is 1 in cases none value is specified in the profile.

- 153 • R:452:ALL:NA:exchange

154 Optional and required attributes and associations must be imported and exported if they
155 are in the model file prior to import.

- 156 • R:452:ALL:NA:exchange1

157 If an optional attribute does not exist in the imported file, it does not have to be exported
158 in case exactly the same data set is exported, i.e. the tool is not obliged to automatically
159 provide this attribute. If the export is resulting from an action by the user performed after
160 the import, e.g. data processing or model update the export can contain optional
161 attributes.

- 162 • R:452:ALL:NA:exchange2

163 In most of the profiles the selection of optional and required attributes is made so as to
164 ensure a minimum set of required attributes without which the exchange does not fulfil
165 its basic purpose. Business processes governing different exchanges can require
166 mandatory exchange of certain optional attributes or associations. Optional and required
167 attributes and associations shall therefore be supported by applications which claim
168 conformance with certain functionalities of the IEC 61970-452. This provides flexibility
169 for the business processes to adapt to different business requirements and base the
170 exchanges on IEC 61970-452 compliant applications.

- 171 • R:452:ALL:NA:exchange3

172 An exporter may, at his or her discretion, produce a serialization containing additional
173 class data described by the CIM Schema but not required by this document provided
174 these data adhere to the conventions established in Clause 5.

- 175 • R:452:ALL:NA:exchange4

176 From the standpoint of the model import used by a data recipient, the document
177 describes a subset of the CIM that importing software shall be able to interpret in order
178 to import exported models. Data providers are free to exceed the minimum requirements
179 described herein as long as their resulting data files are compliant with the CIM Schema
180 and the conventions established in Clause 5. The document, therefore, describes
181 additional classes and class data that, although not required, exporters will, in all
182 likelihood, choose to include in their data files. The additional classes and data are
183 labelled as required (cardinality 1..1) or as optional (cardinality 0..1) to distinguish them
184 from their required counterparts. Please note, however, that data importers could
185 potentially receive data containing instances of any and all classes described by the
186 CIM Schema.

- 187 • R:452:ALL:NA:cardinality

- 188 The cardinality defined in the CIM model shall be followed, unless a more restrictive
189 cardinality is explicitly defined in this document. For instance, the cardinality on the
190 association between VoltageLevel and BaseVoltage indicates that a VoltageLevel shall
191 be associated with one and only one BaseVoltage, but a BaseVoltage can be associated
192 with zero to many VoltageLevels.
- 193 • R:452:ALL:NA:associations
- 194 Associations between classes referenced in this document and classes not referenced
195 here are not required regardless of cardinality.
- 196 • R:452:ALL:IdentifiedObject.name:rule
- 197 The attribute “name” inherited by many classes from the abstract class IdentifiedObject
198 is not required to be unique. It must be a human readable identifier without additional
199 embedded information that would need to be parsed. The attribute is used for purposes
200 such as User Interface and data exchange debugging. The MRID defined in the data
201 exchange format is the only unique and persistent identifier used for this data exchange.
202 The attribute IdentifiedObject.name is, however, always required for CoreEquipment
203 profile and Short Circuit profile.
- 204 • R:452:ALL:IdentifiedObject.description:rule
- 205 The attribute “description” inherited by many classes from the abstract class
206 IdentifiedObject must contain human readable text without additional embedded
207 information that would need to be parsed.
- 208 • R:452:ALL:NA:uniqueIdentifier
- 209 All IdentifiedObject-s shall have a persistent and globally unique identifier (Master
210 Resource Identifier - mRID).
- 211 • R:452:ALL:NA:unitMultiplier
- 212 For exchange of attributes defined using CIM Data Types (ActivePower, Susceptance,
213 etc.) a unit multiplier of 1 is used if the UnitMultiplier specified in this document is “none”.
- 214 • C:452:ALL:IdentifiedObject.name:stringLength
- 215 The string IdentifiedObject.name has a maximum of 128 characters.
- 216 • C:452:ALL:IdentifiedObject.description:stringLength
- 217 The string IdentifiedObject.description is maximum 256 characters.
- 218 • C:452:ALL:NA:float
- 219 An attribute that is defined as float (e.g. has a type Float or a type which is a Datatype
220 with .value attribute of type Float) shall support ISO/IEC 60559:2020 for floating-point
221 arithmetic using single precision floating point. A single precision float supports 7
222 significant digits where the significant digits are described as an integer, or a decimal
223 number with 6 decimal digits. Two float values are equal when the significant with 7
224 digits are identical, e.g. 1234567 is equal 1.234567E6 and so are 1.2345678 and
225 1.234567E0.
- 226

227 2.4 Metadata

228 ENTSO-E agreed to extend the header and metadata definitions by IEC 61970-552 Ed2. This
229 new header definitions rely on W3C recommendations which are used worldwide and are
230 positively recognised by the European Commission. The new definitions of the header mainly
231 use Provenance ontology (PROV-O), Time Ontology and Data Catalog Vocabulary (DCAT). The
232 global new header applicable for this profile is included in the metadata and document header
233 specification document.

234 The header vocabulary contains all attributes defined in IEC 61970-552. This is done only for
235 the purpose of having one vocabulary for header and to ensure transition for data exchanges
236 that are using IEC 61970-552:2016 header. This profile does not use IEC 61970-552:2016
237 header attributes and relies only on the extended attributes.

238 2.4.1 Constraints

239 The identification of the constraints related to the metadata follows the same convention for
240 naming of the constraints as for profile constraints.

- 241 • R:NC:ALL:wasAttributedTo:usage

242 The prov:wasAttributedTo should normally be the “X” EIC code of the actor (prov:Agent).

243


244 2.4.2 Reference metadata

245 The header defined for this profile requires availability of a set of reference metadata. For
246 instance, the attribute prov:wasGeneratedBy requires a reference to an activity which produced
247 the model or the related process. The activities are defined as reference metadata and their
248 identifiers are referenced from the header to enable the receiving entity to retrieve the “static”
249 (reference) information that is not modified frequently. This approach imposes a requirement
250 that both the sending entity and the receiving entity have access to a unique version of the
251 reference metadata. Therefore, each business process shall define which reference metadata
252 is used and where it is located.

253 3 Detailed Profile Specification

254 3.1 General

255 This package contains the power schedule profile.

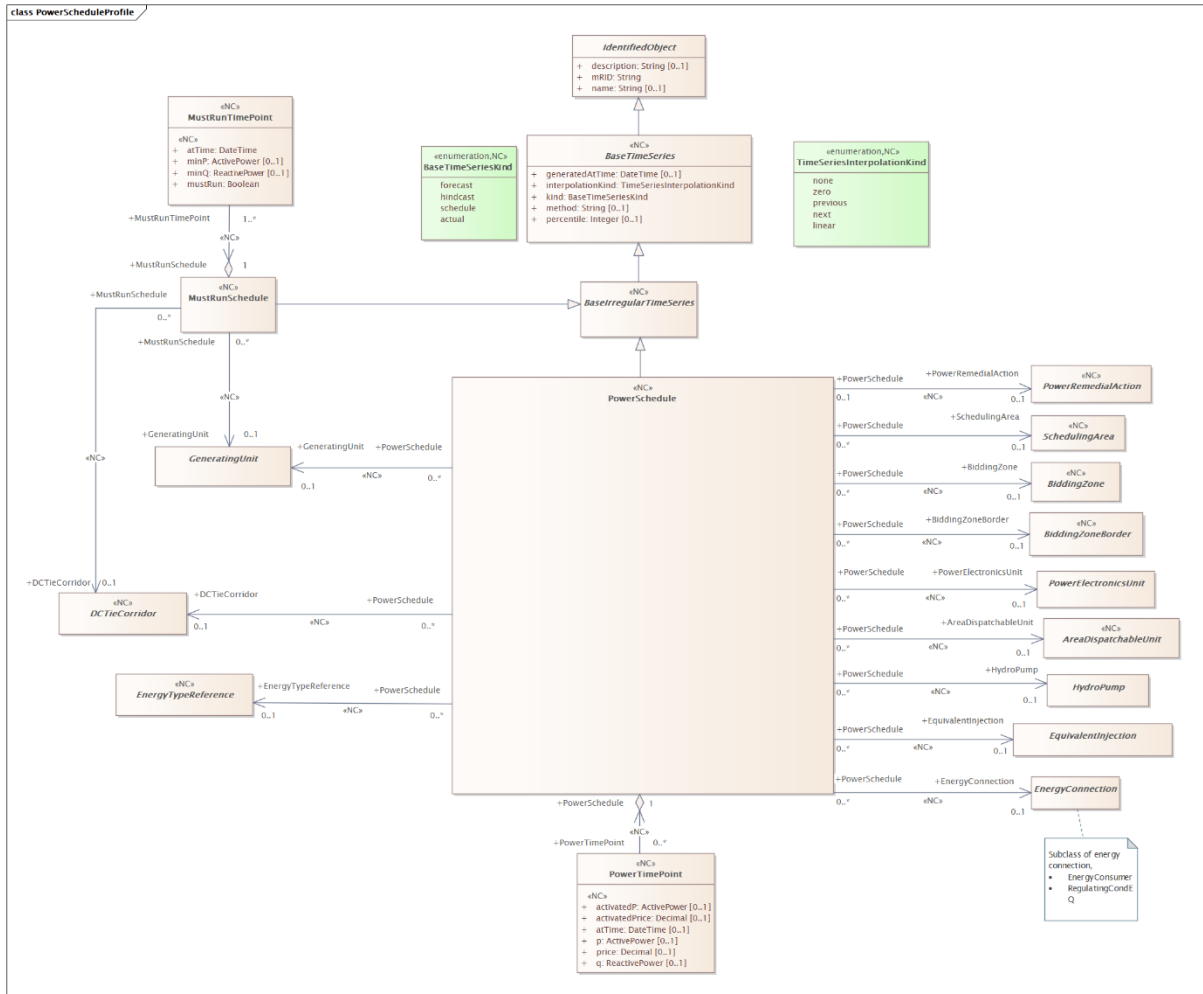

256

257

Figure 1 – Class diagram PowerScheduleProfile::PowerScheduleProfile

258

Figure 1: The diagram contains main classes related to the power schedule profile.

259

3.2 (abstract,NC) AreaDispatchableUnit root class

260

Allocates a given producing or consuming unit, including direct current corridor and collection of units, to a given control area (through the scheduling area) for supporting the control of the given area through dispatch instruction.

263

3.3 (abstract,NC) BaseIrregularTimeSeries

264

Inheritance path = [BaseTimeSeries](#) : [IdentifiedObject](#)

265

Time series that has irregular points in time.

266

Table 1 shows all attributes of BaseIrregularTimeSeries.

267

Table 1 – Attributes of PowerScheduleProfile::BaseIrregularTimeSeries

name	mult	type	description
interpolationKind	1..1	TimeSeriesInterpolationKind	inherited from: BaseTimeSeries
kind	1..1	BaseTimeSeriesKind	inherited from: BaseTimeSeries
generatedAtTime	0..1	DateTime	inherited from: BaseTimeSeries
percentile	0..1	Integer	inherited from: BaseTimeSeries
method	0..1	String	inherited from: BaseTimeSeries

name	mult	type	description
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

268

269 3.4 (abstract,NC) BaseTimeSeries

270 Inheritance path = [IdentifiedObject](#)

271 Time series of values at points in time.

272 Table 2 shows all attributes of BaseTimeSeries.

273

Table 2 – Attributes of PowerScheduleProfile::BaseTimeSeries

name	mult	type	description
interpolationKind	1..1	TimeSeriesInterpolationKind	Kind of interpolation done between time point.
kind	1..1	BaseTimeSeriesKind	Kind of base time series.
generatedAtTime	0..1	DateTime	The time this time series (entity) come to existents and available for use.
percentile	0..1	Integer	The percentile is a number where a certain percentage of scores/ranking/values of a sample fall below that number. This is a way for expressing uncertainty in the number provided.
method	0..1	String	Method used to create the value. This is used for identification in the case where there is multiple time series for the same validity period and kind.
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

274

275 3.5 (abstract,NC) BiddingZone root class

276 A bidding zone is a market-based method for handling power transmission congestion. It
277 consists of scheduling areas that include the relevant production (supply) and consumption
278 (demand) to form an electrical area with the same market price without capacity allocation.

279 3.6 (abstract,NC) BiddingZoneBorder root class

280 Defines the aggregated connection capacity between two Bidding Zones.

281 3.7 (abstract,NC) DCTieCorridor root class

282 A collection of one or more direct current poles that connect two different control areas.

283 3.8 (abstract) EnergyConnection root class

284 A connection of energy generation or consumption on the power system model.

285 3.9 (abstract,NC) EnergyTypeReference root class

286 An energy type reference refers to an energy characteristic that is needed for reporting, e.g.
287 European Energy Certificate System (EECS). The kind of energy should be possible to be linked
288 with different type of energy forecast, e.g. wind production for a given area based on wind
289 forecast.

290 3.10 (abstract) EquivalentInjection root class

291 This class represents equivalent injections (generation or load). Voltage regulation is allowed
292 only at the point of connection.

293 **3.11 (abstract) GeneratingUnit root class**

294 A single or set of synchronous machines for converting mechanical power into alternating-
295 current power. For example, individual machines within a set may be defined for scheduling
296 purposes while a single control signal is derived for the set. In this case there would be a
297 GeneratingUnit for each member of the set and an additional GeneratingUnit corresponding to
298 the set.

299 **3.12 (abstract) HydroPump root class**

300 A synchronous motor-driven pump, typically associated with a pumped storage plant.

301 **3.13 (abstract) IdentifiedObject root class**

302 This is a root class to provide common identification for all classes needing identification and
303 naming attributes.

304 Table 3 shows all attributes of IdentifiedObject.

305 **Table 3 – Attributes of PowerScheduleProfile::IdentifiedObject**

name	mult	type	description
description	0..1	String	The description is a free human readable text describing or naming the object. It may be non unique and may not correlate to a naming hierarchy.
mRID	1..1	String	Master resource identifier issued by a model authority. The mRID is unique within an exchange context. Global uniqueness is easily achieved by using a UUID, as specified in RFC 4122, for the mRID. The use of UUID is strongly recommended. For CIMXML data files in RDF syntax conforming to IEC 61970-552, the mRID is mapped to rdf:ID or rdf:about attributes that identify CIM object elements.
name	0..1	String	The name is any free human readable and possibly non unique text naming the object.

306

307 **3.14 (NC) MustRunSchedule**

308 Inheritance path = [BaseIrregularTimeSeries](#) : [BaseTimeSeries](#) : [IdentifiedObject](#)

309 Time series represent irregular must-run instruction values at given points in time. This could
310 be instruction to a reliability must-run (RMR) generation facility that is necessary to run to meet
311 certain operating conditions in order to maintain the security of power systems in a competitive
312 environment.

313 Table 4 shows all attributes of MustRunSchedule.

314 **Table 4 – Attributes of PowerScheduleProfile::MustRunSchedule**

name	mult	type	description
interpolationKind	1..1	TimeSeriesInterpolationKind	inherited from: BaseTimeSeries
kind	1..1	BaseTimeSeriesKind	inherited from: BaseTimeSeries
generatedAtTime	0..1	DateTime	inherited from: BaseTimeSeries
percentile	0..1	Integer	inherited from: BaseTimeSeries
method	0..1	String	inherited from: BaseTimeSeries
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

315
316 Table 5 shows all association ends of MustRunSchedule with other classes.

317 **Table 5 – Association ends of PowerScheduleProfile::MustRunSchedule with other**
318 **classes**

mult from	name	mult to	type	description
0..*	DCTieCorridor	0..1	DCTieCorridor	(NC) Hydro pump which belongs to the power schedule.
0..*	GeneratingUnit	0..1	GeneratingUnit	(NC) Generating unit which belongs to the must run schedule.

319
320 **3.15 (NC) MustRunTimePoint root class**

321 Must-run instruction value at a given point in time.
322 Table 6 shows all attributes of MustRunTimePoint.

323 **Table 6 – Attributes of PowerScheduleProfile::MustRunTimePoint**

name	mult	type	description
atTime	1..1	DateTime	(NC) The time the data is valid for.
mustRun	1..1	Boolean	(NC) True, if the must-run instruction is active this time point. Otherwise false.
minP	0..1	ActivePower	(NC) Minimum active power injection that is needed to meet must-run requirement. This value can be higher or equal to minimum operational limit. Load sign convention is used, i.e. positive sign means flow out from a node.
minQ	0..1	ReactivePower	(NC) Minimum reactive power injection that is needed to meet must-run requirement. This value can be higher or equal to minimum operational limit. Load sign convention is used, i.e. positive sign means flow out from a node.

324
325 Table 7 shows all association ends of MustRunTimePoint with other classes.

326 **Table 7 – Association ends of PowerScheduleProfile::MustRunTimePoint with other**
327 **classes**

mult from	name	mult to	type	description
1..*	MustRunSchedule	1..1	MustRunSchedule	(NC) Time series the time point values belongs to.

328
329 **3.16 (abstract) PowerElectronicsUnit root class**

330 A generating unit or battery or aggregation that connects to the AC network using power
331 electronics rather than rotating machines.

332 **3.17 (abstract,NC) PowerRemedialAction root class**

333 Energy remedial action describes actions to rearrange power schedules.

334 **3.18 (NC) PowerSchedule**

335 Inheritance path = [BaseIrregularTimeSeries](#) : [BaseTimeSeries](#) : [IdentifiedObject](#)
336 Time series represent irregular power, active and reactive, values at given points in time.
337 Table 8 shows all attributes of PowerSchedule.

338

Table 8 – Attributes of PowerScheduleProfile::PowerSchedule

name	mult	type	description
interpolationKind	1..1	TimeSeriesInterpolationKind	inherited from: BaseTimeSeries
kind	1..1	BaseTimeSeriesKind	inherited from: BaseTimeSeries
generatedAtTime	0..1	DateTime	inherited from: BaseTimeSeries
percentile	0..1	Integer	inherited from: BaseTimeSeries
method	0..1	String	inherited from: BaseTimeSeries
description	0..1	String	inherited from: IdentifiedObject
mRID	1..1	String	inherited from: IdentifiedObject
name	0..1	String	inherited from: IdentifiedObject

339

340

Table 9 shows all association ends of PowerSchedule with other classes.

341

Table 9 – Association ends of PowerScheduleProfile::PowerSchedule with other classes

mult from	name	mult to	type	description
0..*	AreaDispatchableUnit	0..1	AreaDispatchableUnit	(NC) Area disptachable unit which belongs to the power schedule.
0..*	BiddingZone	0..1	BiddingZone	(NC) Bidding zone which has powerschedules.
0..*	DCTieCorridor	0..1	DCTieCorridor	(NC) DC tie corridor which belongs to the power schedule.
0..*	EnergyConnection	0..1	EnergyConnection	(NC) The energy connection that has a power schedule.
0..*	EnergyTypeReference	0..1	EnergyTypeReference	(NC) Energy type reference which belongs to the power bidding zone.
0..*	GeneratingUnit	0..1	GeneratingUnit	(NC) Generating unit which belongs to the power schedule.
0..*	HydroPump	0..1	HydroPump	(NC) Hydro pump which belongs to the power schedule.
0..*	PowerElectronicsUnit	0..1	PowerElectronicsUnit	(NC) Power electronics unit which belongs to the power schedule.
0..1	PowerRemedialAction	0..1	PowerRemedialAction	(NC) Power remedial action which belongs to the Remedial Action Schedule.
0..*	SchedulingArea	0..1	SchedulingArea	Scheduling area which has power schedules.
0..*	BiddingZoneBorder	0..1	BiddingZoneBorder	(NC) Bidding zone border which belongs to the power schedule.
0..*	EquivalentInjection	0..1	EquivalentInjection	(NC) Equivalent injection which belongs to the power schedule.

342

343

3.19 (NC) PowerTimePoint root class

344

Power, active and reactive, value at a given point in time.

345

Table 10 shows all attributes of PowerTimePoint.

346

Table 10 – Attributes of PowerScheduleProfile::PowerTimePoint

name	mult	type	description
atTime	0..1	DateTime	(NC) The time the data is valid for.
p	0..1	ActivePower	(NC) Active power injection. Load sign convention is used, i.e. positive sign means flow out from a node.
q	0..1	ReactivePower	(NC) Reactive power injection. Load sign convention is used, i.e. positive sign means flow out from a node.
price	0..1	Decimal	(NC) Price for the scheduled active power per unit of active power. e.g. per MW.
activatedP	0..1	ActivePower	(NC) Active power activated as part of redispatch. Negative number means that the value is scheduling down. Positive number means that the value is scheduling up.
activatedPrice	0..1	Decimal	(NC) Price for the activated active power per unit e.g. per MW.

347

348

Table 11 shows all association ends of PowerTimePoint with other classes.

349

350

Table 11 – Association ends of PowerScheduleProfile::PowerTimePoint with other classes

mult from	name	mult to	type	description
0..*	PowerSchedule	1..1	PowerSchedule	(NC) Time series the time point values belongs to.

351

352 3.20 (abstract,NC) SchedulingArea root class

353 An area where production and/or consumption of energy can be forecasted, scheduled and
354 measured. The area is operated by only one system operator, typically a Transmission System
355 Operator (TSO). The area can consist of a sub area, which has the same definition as the main
356 area, but it can be operated by another system operator (typically Distributed System Operator
357 (DSO) or a Closed Distributed System Operator (CDSO)). This includes microgrid concept. A
358 substation is the smallest grouping that can be included in the area. The area size should be
359 considered in terms of the possibility of accumulated reading (settlement metering) and the
360 capability of operating as an island.

361 3.21 ActivePower datatype

362 Product of RMS value of the voltage and the RMS value of the in-phase component of the
363 current.

364 Table 12 shows all attributes of ActivePower.

365

Table 12 – Attributes of PowerScheduleProfile::ActivePower

name	mult	type	description
multiplier	0..1	UnitMultiplier	(const=M)
unit	0..1	UnitSymbol	(const=W)
value	0..1	Float	

366

367 3.22 ReactivePower datatype

368 Product of RMS value of the voltage and the RMS value of the quadrature component of the
369 current.

370 Table 13 shows all attributes of ReactivePower.

371

Table 13 – Attributes of PowerScheduleProfile::ReactivePower

name	mult	type	description
value	0..1	Float	
unit	0..1	UnitSymbol	(const=VAr)
multiplier	0..1	UnitMultiplier	(const=M)

372

3.23 (NC) BaseTimeSeriesKind enumeration

374 Kind of time series.

375 Table 14 shows all literals of BaseTimeSeriesKind.

376

Table 14 – Literals of PowerScheduleProfile::BaseTimeSeriesKind

literal	value	description
forecast		Time series is forecast data. The values represent the result of scientific predictions based on historical time stamped data.
hindcast		Time series is hindcast data. The value represent probable past (historic) condition given by calculation done using actual values. For instance, determine the among of wind based on the energy produced by wind. However, hindcast is typical the result of a simulated forecasts for historical periods.
schedule		Time series is schedule data. The values represent the result of a committed and plan forecast data that has been through a quality control and could incur penalty when not followed.
actual		Time series is actual data. The values represent measured or calculated values that represent the actual behaviour.

377

3.24 (NC) TimeSeriesInterpolationKind enumeration

379 Kinds of interpolation of values between two time point.

380 Table 15 shows all literals of TimeSeriesInterpolationKind.

381

Table 15 – Literals of PowerScheduleProfile::TimeSeriesInterpolationKind

literal	value	description
none		No interpolation is applied.
zero		The value between two time points is set to zero.
previous		The value between two time points is set to previous value.
next		The value between two time points is set to next value.
linear		Linear interpolation is applied for values between two time points.

382

3.25 UnitSymbol enumeration

384 The derived units defined for usage in the CIM. In some cases, the derived unit is equal to an
 385 SI unit. Whenever possible, the standard derived symbol is used instead of the formula for the
 386 derived unit. For example, the unit symbol Farad is defined as "F" instead of "CPerV". In cases
 387 where a standard symbol does not exist for a derived unit, the formula for the unit is used as

388 the unit symbol. For example, density does not have a standard symbol and so it is represented
389 as "kgPerm3". With the exception of the "kg", which is an SI unit, the unit symbols do not contain
390 multipliers and therefore represent the base derived unit to which a multiplier can be applied as
391 a whole.

392 Every unit symbol is treated as an unparseable text as if it were a single-letter symbol. The
393 meaning of each unit symbol is defined by the accompanying descriptive text and not by the
394 text contents of the unit symbol.

395 To allow the widest possible range of serializations without requiring special character handling,
396 several substitutions are made which deviate from the format described in IEC 80000-1. The
397 division symbol "/" is replaced by the letters "Per". Exponents are written in plain text after the
398 unit as "m3" instead of being formatted as "m" with a superscript of 3 or introducing a symbol
399 as in "m^3". The degree symbol "°" is replaced with the letters "deg". Any clarification of the
400 meaning for a substitution is included in the description for the unit symbol.

401 Non-SI units are included in list of unit symbols to allow sources of data to be correctly labelled
402 with their non-SI units (for example, a GPS sensor that is reporting numbers that represent feet
403 instead of meters). This allows software to use the unit symbol information correctly convert
404 and scale the raw data of those sources into SI-based units.

405 The integer values are used for harmonization with IEC 61850.

406 Table 16 shows all literals of UnitSymbol.

407

Table 16 – Literals of PowerScheduleProfile::UnitSymbol

literal	value	description
W	38	Real power in watts (J/s). Electrical power may have real and reactive components. The real portion of electrical power (I^2R or $VI\cos(\phi)$), is expressed in Watts. See also apparent power and reactive power.
VAr	63	Reactive power in volt amperes reactive. The "reactive" or "imaginary" component of electrical power ($VI\sin(\phi)$). (See also real power and apparent power). Note: Different meter designs use different methods to arrive at their results. Some meters may compute reactive power as an arithmetic value, while others compute the value vectorially. The data consumer should determine the method in use and the suitability of the measurement for the intended purpose.

408

409 **3.26 UnitMultiplier enumeration**

410 The unit multipliers defined for the CIM. When applied to unit symbols, the unit symbol is
411 treated as a derived unit. Regardless of the contents of the unit symbol text, the unit symbol
412 shall be treated as if it were a single-character unit symbol. Unit symbols should not contain
413 multipliers, and it should be left to the multiplier to define the multiple for an entire data type.

414 For example, if a unit symbol is "m2Pers" and the multiplier is "k", then the value is $k(m^{**2}/s)$,
415 and the multiplier applies to the entire final value, not to any individual part of the value. This
416 can be conceptualized by substituting a derived unit symbol for the unit type. If one imagines
417 that the symbol "P" represents the derived unit "m2Pers", then applying the multiplier "k" can
418 be conceptualized simply as "kP".

419 For example, the SI unit for mass is "kg" and not "g". If the unit symbol is defined as "kg", then
420 the multiplier is applied to "kg" as a whole and does not replace the "k" in front of the "g". In
421 this case, the multiplier of "m" would be used with the unit symbol of "kg" to represent one gram.
422 As a text string, this violates the instructions in IEC 80000-1. However, because the unit symbol
423 in CIM is treated as a derived unit instead of as an SI unit, it makes more sense to conceptualize
424 the "kg" as if it were replaced by one of the proposed replacements for the SI mass symbol. If
425 one imagines that the "kg" were replaced by a symbol "P", then it is easier to conceptualize the
426 multiplier "m" as creating the proper unit "mP", and not the forbidden unit "mkg".

427 Table 17 shows all literals of UnitMultiplier.

428

Table 17 – Literals of PowerScheduleProfile::UnitMultiplier

literal	value	description
M	6	Mega 10**6.

429

430 3.27 Boolean primitive

431 A type with the value space "true" and "false".

432 3.28 DateTime primitive

433 Date and time as "yyyy-mm-ddThh:mm:ss.sss", which conforms with ISO 8601. UTC time zone
434 is specified as "yyyy-mm-ddThh:mm:ss.sssZ". A local timezone relative UTC is specified as
435 "yyyy-mm-ddThh:mm:ss.sss-hh:mm". The second component (shown here as "ss.sss") could
436 have any number of digits in its fractional part to allow any kind of precision beyond seconds.

437 3.29 Decimal primitive

438 Decimal is the base-10 notational system for representing real numbers.

439 3.30 Float primitive

440 A floating point number. The range is unspecified and not limited.

441 3.31 Integer primitive

442 An integer number. The range is unspecified and not limited.

443 3.32 String primitive

444 A string consisting of a sequence of characters. The character encoding is UTF-8. The string
445 length is unspecified and unlimited.

446

447

448

449

Annex A (informative): Sample data

A.1 General

451 This Annex is designed to illustrate the profile by using fragments of sample data. It is not meant
452 to be a complete set of examples covering all possibilities of using the profile. Defining a
453 complete set of test data is considered a separate activity to be performed for the purpose of
454 setting up interoperability testing and conformity related to this profile.

A.2 Sample instance data

456 Test data files are available in the CIM EG SharePoint.

457

458