

Quarterly Report Q1/2023 according to article 9(4) of the common methodology for the pricing of balancing energy and cross-border capacity

23 June 2023

From: ENTSO-E

ENTSO-E Mission Statement

Who we are

ENTSO-E, the European Network of Transmission System Operators for Electricity, is the association for the cooperation of the European transmission system operators (TSOs). The 39 member TSOs, representing 35 countries, are responsible for the secure and coordinated operation of Europe's electricity system, the largest interconnected electrical grid in the world. In addition to its core, historical role in technical cooperation, ENTSO-E is also the common voice of TSOs.

ENTSO-E brings together the unique expertise of TSOs for the benefit of European citizens by keeping the lights on, enabling the energy transition, and promoting the completion and optimal functioning of the internal electricity market, including via the fulfilment of the mandates given to ENTSO-E based on EU legislation.

Our mission

ENTSO-E and its members, as the European TSO community, fulfil a common mission: Ensuring the security of the inter-connected power system in all time frames at pan-European level and the optimal functioning and development of the European interconnected electricity markets, while enabling the integration of electricity generated from renewable energy sources and of emerging technologies.

Our vision

ENTSO-E plays a central role in enabling Europe to become the first climate-neutral continent by 2050 by creating a system that is secure, sustainable and affordable, and that integrates the expected amount of renewable energy, thereby offering an essential contribution to the European Green Deal. This endeavour requires sector integration and close cooperation among all actors.

Europe is moving towards a sustainable, digitalised, integrated and electrified energy system with a combination of centralised and distributed resources. ENTSO-E acts to ensure that this energy system keeps consumers at its centre and is operated and developed with climate objectives and social welfare in mind.

ENTSO-E is committed to use its unique expertise and system-wide view – supported by a responsibility to maintain the system's security – to deliver a comprehensive roadmap of how a climate-neutral Europe looks.

Our values

ENTSO-E acts in solidarity as a community of TSOs united by a shared responsibility.

As the professional association of independent and neutral regulated entities acting under a clear legal mandate, ENTSO-E serves the interests of society by optimising social welfare in its dimensions of safety, economy, environment, and performance.

ENTSO-E is committed to working with the highest technical rigour as well as developing sustainable and innovative responses to prepare for the future and overcoming the challenges of keeping the power system secure in a climate-neutral Europe. In all its activities, ENTSO-E acts with transparency and in a trustworthy dialogue with legislative and regulatory decision makers and stakeholders.

Our contributions

ENTSO-E supports the cooperation among its members at European and regional levels. Over the past decades, TSOs have undertaken initiatives to increase their cooperation in network planning, operation and market integration, thereby successfully contributing to meeting EU climate and energy targets.

To carry out its legally mandated tasks, ENTSO-E's key responsibilities include the following:

- › Development and implementation of standards, network codes, platforms and tools to ensure secure system and market operation as well as integration of renewable energy;
- › Assessment of the adequacy of the system in different timeframes;
- › Coordination of the planning and development of infrastructures at the European level (Ten-Year Network Development Plans, TYNDPs);
- › Coordination of research, development and innovation activities of TSOs;
- › Development of platforms to enable the transparent sharing of data with market participants.

ENTSO-E supports its members in the implementation and monitoring of the agreed common rules.

ENTSO-E is the common voice of European TSOs and provides expert contributions and a constructive view to energy debates to support policymakers in making informed decisions.

Table of CONTENT

1. Background of the report	4
2. Scope of the report	5
3. Indicators of the balancing energy price formation	5
3.1 Monthly average values of used and available cross-zonal capacity for the exchange of balancing energy	5
3.2 Average percentage of submitted and activated standard balancing energy bids compared the upper (and lower) transitional price limit	10
3.3 Volume weighted average price of the most expensive balancing energy bids	14
4. Analysis of the price incidents	18
4.1 Analysis of the aFRR pricing spikes	18
4.2 Analysis of the mFRR pricing incidents	22
4.3 Analysis of the RR pricing incidents	24
List of figures	25
List of tables	26
Annex – Calculation formulas for the PIs	26

1. Background of the report

According to its decision 03/2022¹ published in February 2022², ACER has amended the methodology for pricing balancing energy and cross-zonal capacity used for the exchange of balancing energy or operating the imbalance netting process in accordance with Article 30(1) of Commission Regulation (EU) 2017/2195 establishing a guideline on electricity balancing ('Balancing Pricing Methodology' hereafter)³.

As a main element, article 9(3) of the amended Balancing Pricing Methodology introduces a transitory upper price limit of 15 000 EUR/MWh and a transitory lower price limit of – 15 000 EUR/MWh for the first 4 years of the European balancing platforms' operations, until July 2026.⁴ These price limits apply for the TSOs participating in the RR-Platform from 1 July 2022.

Furthermore, article 9(4) of the amended Balancing Pricing Methodology requires all TSOs to report to ACER and regulatory authorities on quarterly basis on the balancing energy price formation during the transitional period (see above). In particular, all TSOs have to submit the following indicators:

- a) monthly average values of used and available cross-zonal capacity for the exchange of balancing energy per each bidding zone border and direction;
- b) average percentage of both submitted and activated standard balancing energy bids per product and per direction with prices higher (and lower) than 50%, 75%, 90%, 95% and 99% of the upper (and lower) transitional price limit;
- c) volume weighted average price of the last (most expensive) 5% of the volume of submitted standard balancing energy bids for each European balancing platform per direction and per participating TSO;

In addition, it was agreed with ACER and regulatory authorities to include the analysis of the pricing incidents according to article 9(5) of the amended Balancing Pricing Methodology in the quarterly reports. By the present report, all TSOs fulfil the obligations according to article 9(4) of the amended Balancing Pricing Methodology.

¹ ACER decision 03/2022:

https://www.acer.europa.eu/sites/default/files/documents/Individual%20Decisions/ACER%20Decision%2003-2022%20on%20the%20Amendment%20to%20the%20Methodology%20for%20Pricing%20Balancing%20Energy_0.pdf

² Press release by ACER:

<https://www.acer.europa.eu/events-and-engagement/news/acer-has-decided-amendment-common-pricing-methodology-european>

³ Amendment of Balancing Pricing Methodology:

https://www.acer.europa.eu/sites/default/files/documents/Individual%20Decisions_annex/ACER%20Decision%2003-2022%20on%20the%20Amendment%20of%20the%20pricing%20methodology%20-%20Annex%20I_0.pdf

⁴ If the harmonised maximum clearing price for the single intraday coupling in accordance with Article 54(1) of Commission Regulation (EU) 2015/1222 increases above 9,999 €/MWh, the transitional upper price limit in accordance with subparagraph (a) shall automatically increase by the same amount. In this case, the transitional lower price limit shall be decreased to the same absolute value.

2. Scope of the report

This report covers the operational period from 1 January to 31 March 2023 for the European balancing platforms PICASSO, MARI, and TERRE in line with the requirements stipulated in the amended Pricing Methodology.

3. Indicators of the balancing energy price formation

3.1 Monthly average values of used and available cross-zonal capacity for the exchange of balancing energy

The monthly average values of used and available cross-zonal capacity (CZC) for the exchange of balancing energy are calculated for each balancing energy platform per bidding zone border in both directions. Please note that the calculation of monthly average values does not allow to draw specific conclusions about the availability of CZC in single MTUs. Please note also that the use of CZC from A to B does not distinguish between fulfilment of an upward balancing energy demand in B or fulfilment of a downward balancing energy demand in A.

Legal reference	Article 9(4) of the common methodology for the pricing of balancing energy and cross-border capacity
Data source	aFRR, mFRR and RR platforms
Calculation	<ol style="list-style-type: none"> 1. CZC available per BZ border and direction for the aFRR/mFRR/RR exchange 2. CZC used per BZ border and direction for the aFRR/mFRR/RR exchange

1) PICASSO - Monthly average values of used and available CZC

	January 2023		February 2023		March 2023	
	Available CZC	Used CZC	Available CZC	Used CZC	Available CZC	Used CZC
DE -> CZ	240	13	293	12	199	13
CZ -> DE	607	23	644	31	697	30
DE -> AT	253	47	274	45	381	45
AT -> DE	2185	38	1645	37	1392	51
CZ -> AT	106	8	137	12	197	16
AT -> CZ	1189	36	904	34	782	36

Table 1: PICASSO – Monthly average values of used and available cross-zonal capacity for the exchange of aFRR [MW]

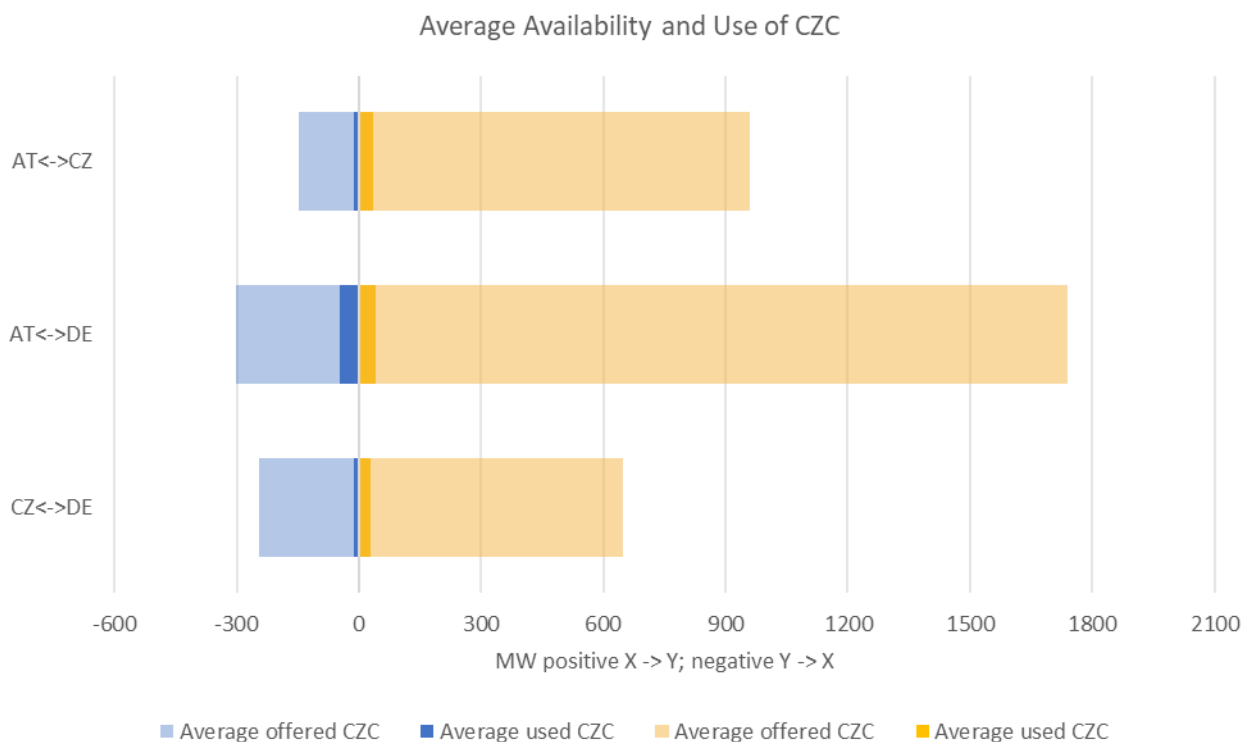


Figure 1: PICASSO – Average used and available cross-zonal capacity for the exchange of aFRR between 1 January and 31 March 2023 [MW]

2) MARI – Monthly average values of used and available CZC

	January 2023		February 2023		March 2023	
	Available CZC	Used CZC	Available CZC	Used CZC	Available CZC	Used CZC
DE -> CZ	240	0	315	0	210	0
CZ -> DE	607	0	659	0	706	0

Table 2: MARI – Monthly average values of used and available cross-zonal capacity for the exchange of mFRR [MW]

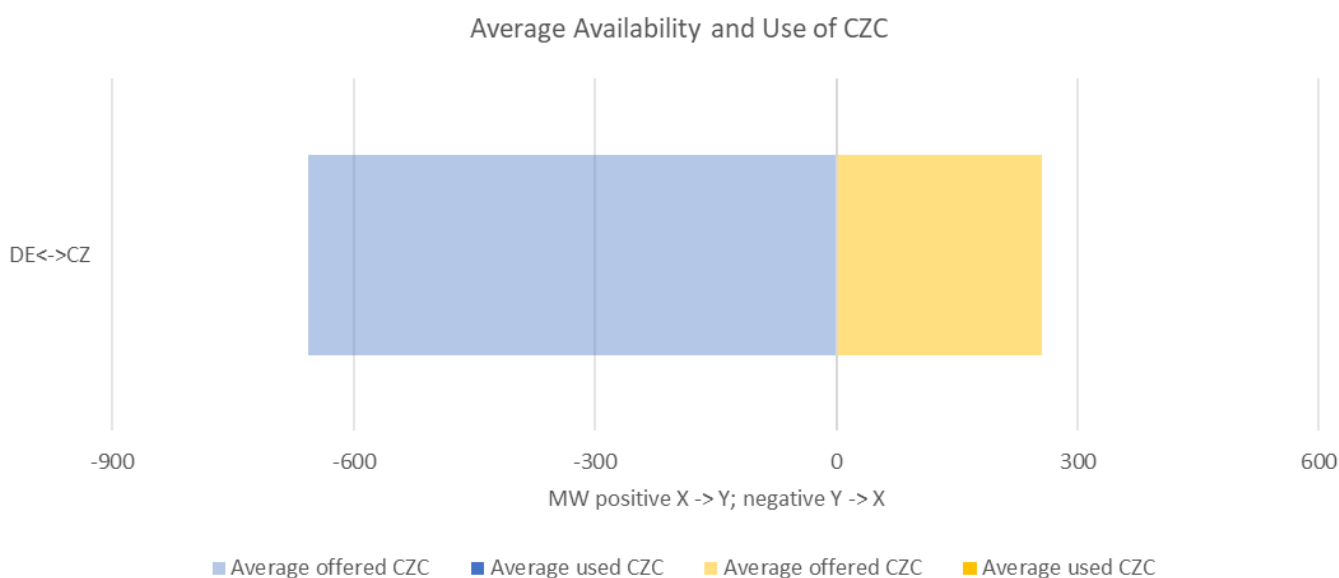


Figure 2: MARI – Average used and available cross-zonal capacity for the exchange of mFRR between 1 January and 31 March 2023 [MW]

3) TERRE - Monthly average values of used and available CZC

	January 2023		February 2023		March 2023	
	Available CZC	Used CZC	Available CZC	Used CZC	Available CZC	Used CZC
ES -> FR	145	44	453	173	471	120
ES -> PT	1412	232	3393	186	4760	313
FR -> ES	496	81	346	178	318	152
FR -> CH	2765	157	3640	239	2681	158
FR -> IT	795	76	4464	164	3402	175
CH -> FR	1984	160	1734	129	2028	129
CH -> IT	222	58	4612	72	3900	58
IT -> FR	3604	131	950	113	1072	84
IT -> CH	4259	93	1069	97	523	105
PT -> ES	3488	166	3670	245	2004	235

Table 3: TERRE – Monthly average values of used and available cross-zonal capacity for the exchange of RR [MW]

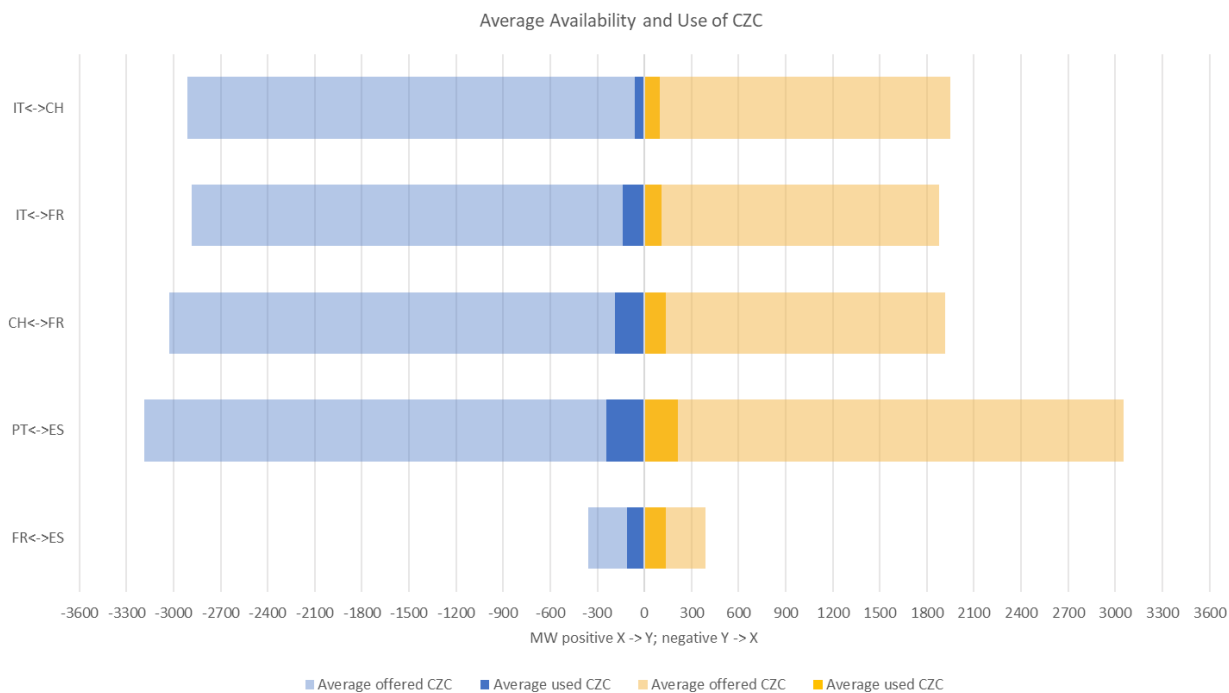


Figure 3: TERRE– Average used and available cross-zonal capacity for the exchange of RR between 1 January and 31 March 2023 [MW]

3.2 Average percentage of submitted and activated standard balancing energy bids compared the upper (and lower) transitional price limit

This PI calculates the average percentage of all submitted (CMOL) and selected standard balancing energy bids on a monthly basis. In total, 20 values are to be reported per platform: five values (50%, 75%, 90%, 95% and 99%) in upward and respectively in downward direction for a) submitted and b) selected balancing energy bids.

Legal reference	Article 9(4) of the common methodology for the pricing of balancing energy and cross-border capacity
Data source	aFRR, mFRR and RR platforms
Calculation	<ol style="list-style-type: none"> 1. Submitted upward balancing energy bids with prices higher than [50%, 75%, 90%, 95%, 99%] of the transitional price limit 2. Submitted downward balancing energy bids with prices lower than [50%, 75%, 90%, 95%, 99%] of the transitional price limit 3. Upward balancing energy with prices higher than [50%, 75%, 90%, 95%, 99%] of the transitional price limit 4. Downward balancing energy with prices lower than [50%, 75%, 90%, 95%, 99%] of the transitional price limit

1) PICASSO – Average percentage of submitted aFRR bids with prices more expensive than 50%, 75%, 90%, 95% and 99% of the transitional price limit

Threshold	Positive aFRR					Negative aFRR				
	50%	75%	90%	95%	99%	50%	75%	90%	95%	99%
January 2023	13.6%	10.3%	8.6%	8.3%	8.0%	11.8%	9.6%	8.5%	8.2%	7.9%
February 2023	11.3%	9.0%	7.4%	7.1%	6.9%	7.9%	6.2%	5.6%	5.4%	5.3%
March 2023	7.0%	5.7%	5.0%	4.8%	4.7%	7.7%	5.6%	5.1%	4.9%	4.6%

Table 4: PICASSO – Average percentage of submitted bids over certain price limits

2) PICASSO – Average percentage of selected aFRR bids with prices more expensive than 50%, 75%, 90%, 95% and 99% of the transitional price limit

Threshold	Positive aFRR					Negative aFRR				
	50%	75%	90%	95%	99%	50%	75%	90%	95%	99%
January 2023	0.013%	0.003%	0.003%	0.003%	0.003%	0.021%	0.018%	0.015%	0.014%	0.013%
February 2023	0.013%	0.005%	0.003%	0.003%	0.003%	0.019%	0.010%	0.008%	0.008%	0.008%
March 2023	0.231%	0.157%	0.152%	0.149%	0.146%	0.028%	0.016%	0.012%	0.010%	0.009%

Table 5: PICASSO – Average percentage of selected bids over certain price limits

3) MARI – Average percentage of submitted mFRR bids with prices more expensive than 50%, 75%, 90%, 95% and 99% of the transitional price limit

Threshold	Positive mFRR					Negative mFRR				
	50%	75%	90%	95%	99%	50%	75%	90%	95%	99%
January 2023	28.4%	20.2%	18.2%	17.9%	16.0%	17.0%	10.8%	8.6%	8.1%	7.128%
February 2023	23.6%	17.9%	16.7%	16.4%	14.3%	15.0%	10.4%	9.0%	7.5%	6.7%
March 2023	20.4%	14.2%	13.1%	13.0%	11.2%	20.5%	13.8%	12.3%	11.4%	10.3%

Table 6: MARI – Average percentage of submitted bids over certain price limits

4) MARI – Average percentage of selected mFRR bids with prices more expensive than 50%, 75%, 90%, 95% and 99% of the transitional price limit

Threshold	Positive mFRR					Negative mFRR				
	50%	75%	90%	95%	99%	50%	75%	90%	95%	99%
January 2023	-	-	-	-	-	0.02%	-	-	-	-
February 2023	-	-	-	-	-	-	-	-	-	-
March 2023	7.89%	7.89%	7.89%	7.89%	7.89%	22.70%	1.25%	1.25%	1.25%	-

Table 7: MARI – Average percentage of selected bids over certain price limits

23 June 2023

5) TERRE – Average percentage of submitted RR bids with prices more expensive than 50%, 75%, 90%, 95% and 99% of the transitional price limit

Threshold	Positive RR					Negative RR				
	50%	75%	90%	95%	99%	50%	75%	90%	95%	99%
January 2023	0.61%	0.34%	0.33%	0.29%	0.26%	1.24%	1.12%	0.65%	0.62%	0.62%
February 2023	0.98%	0.62%	0.49%	0.27%	0.22%	0.37%	0.37%	0.20%	0.20%	0.20%
March 2023	0.90%	0.49%	0.39%	0.35%	0.32%	0.21%	0.20%	0.20%	0.20%	0.20%

Table 8: TERRE – Average percentage of submitted bids over certain price limits

6) TERRE – Average percentage of selected RR bids with prices more expensive than 50%, 75%, 90%, 95% and 99% of the transitional price limit

Threshold	Positive RR					Negative RR				
	50%	75%	90%	95%	99%	50%	75%	90%	95%	99%
January 2023	-	-	-	-	-	-	-	-	-	-
February 2023	-	-	-	-	-	-	-	-	-	-
March 2023	-	-	-	-	-	-	-	-	-	-

Table 9: TERRE – Average percentage of selected bids over certain price limits

3.3 Volume weighted average price of the most expensive balancing energy bids

The VWAP of the last 5% of the submitted bids per platform, per direction and per participating TSO is calculated on a monthly basis. Each balancing platform provides two values per connected TSO, one for upward and one for downward direction.

Legal reference	Article 9(4) of the common methodology for the pricing of balancing energy and cross-border capacity
Data source	aFRR, mFRR and RR platforms
Calculation	<ol style="list-style-type: none">1. VWAP of the last 5% of the upward balancing energy bids submitted per TSO connected to the platform2. VWAP of the last 5% of the downward balancing energy bids submitted per TSO connected to the platform

1) PICASSO – VWAP of the 5% most expensive aFRR bids submitted

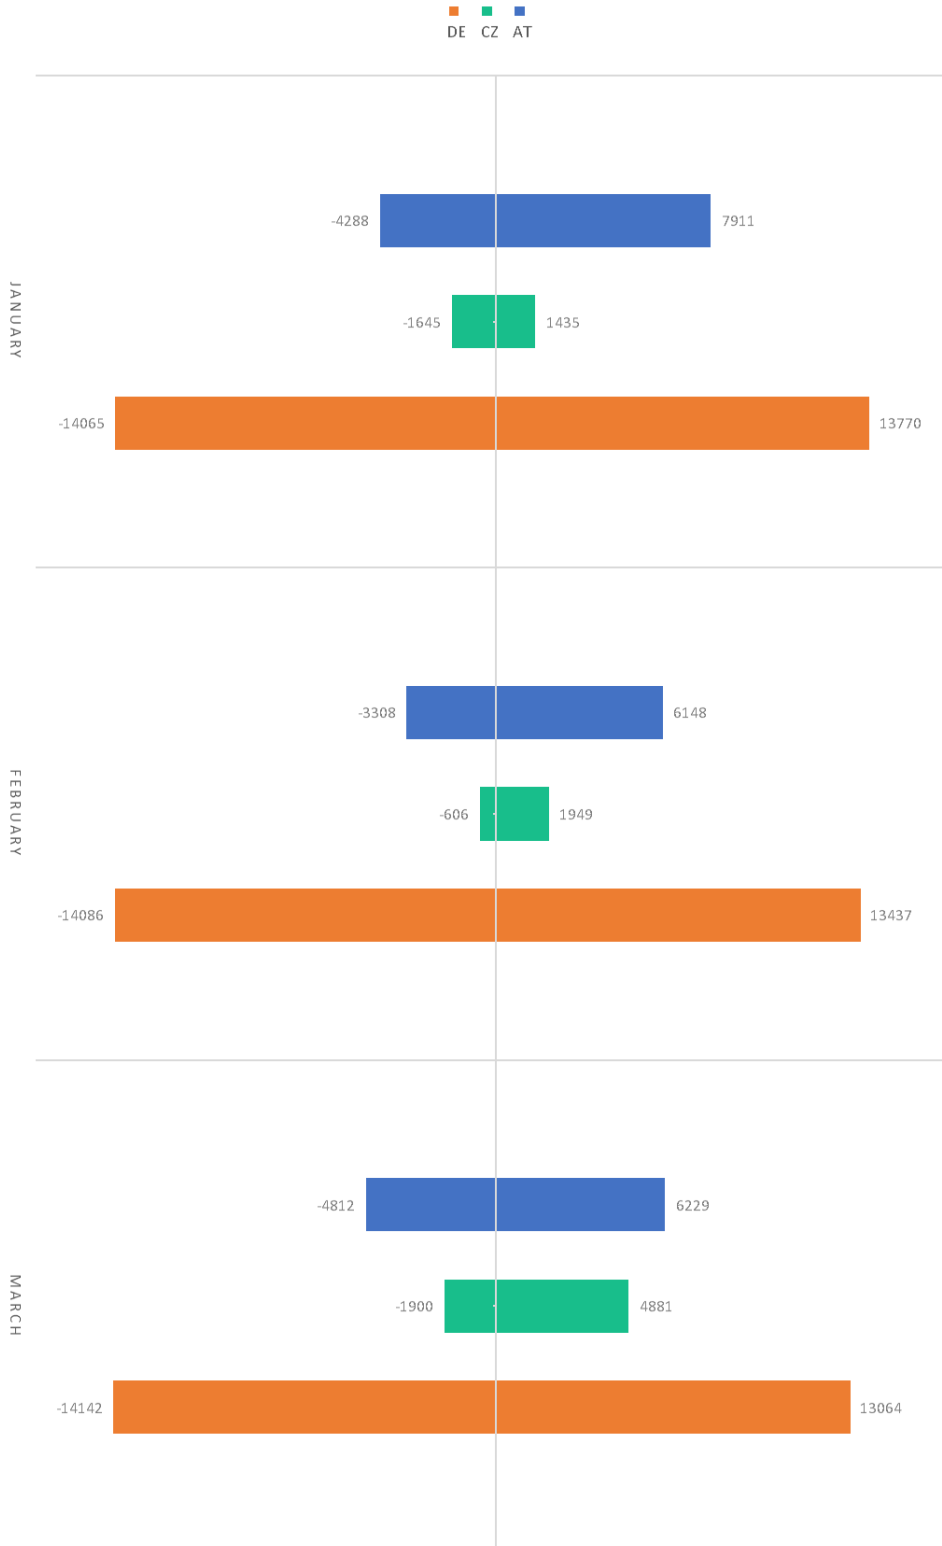


Figure 4: PICASSO - VWAP of the 5% most expensive aFRR bids submitted [EUR/MWh] per country

2) MARI – VWAP of the 5% most expensive mFRR bids submitted

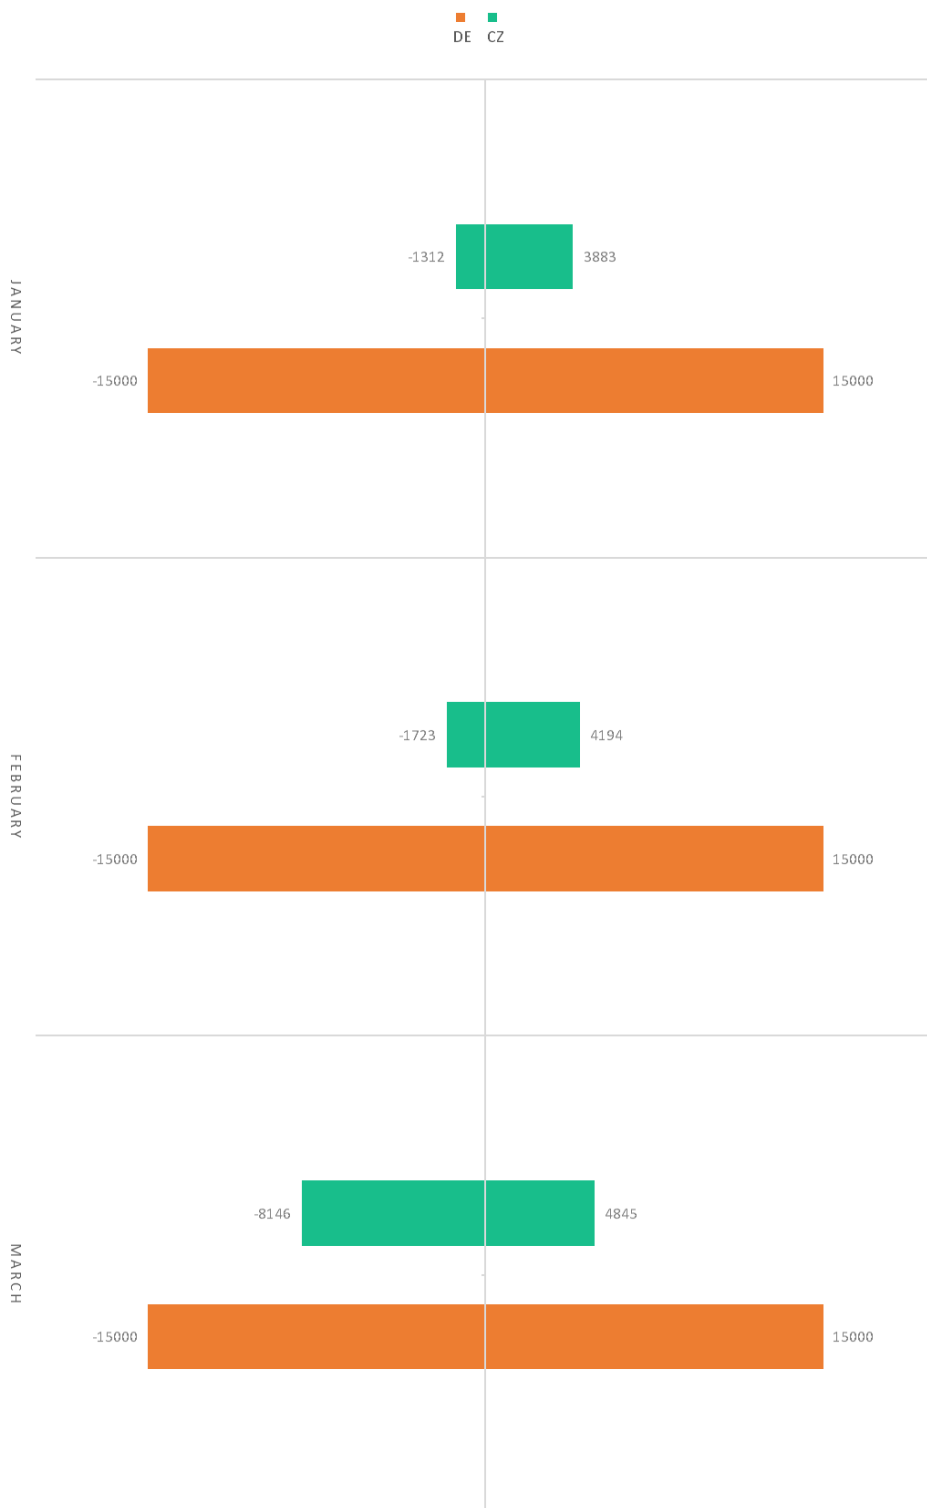


Figure 5: MARI - VWAP of the 5% most expensive mFRR bids submitted [EUR/MWh] per country

3) TERRE – VWAP of the 5% most expensive RR bids submitted

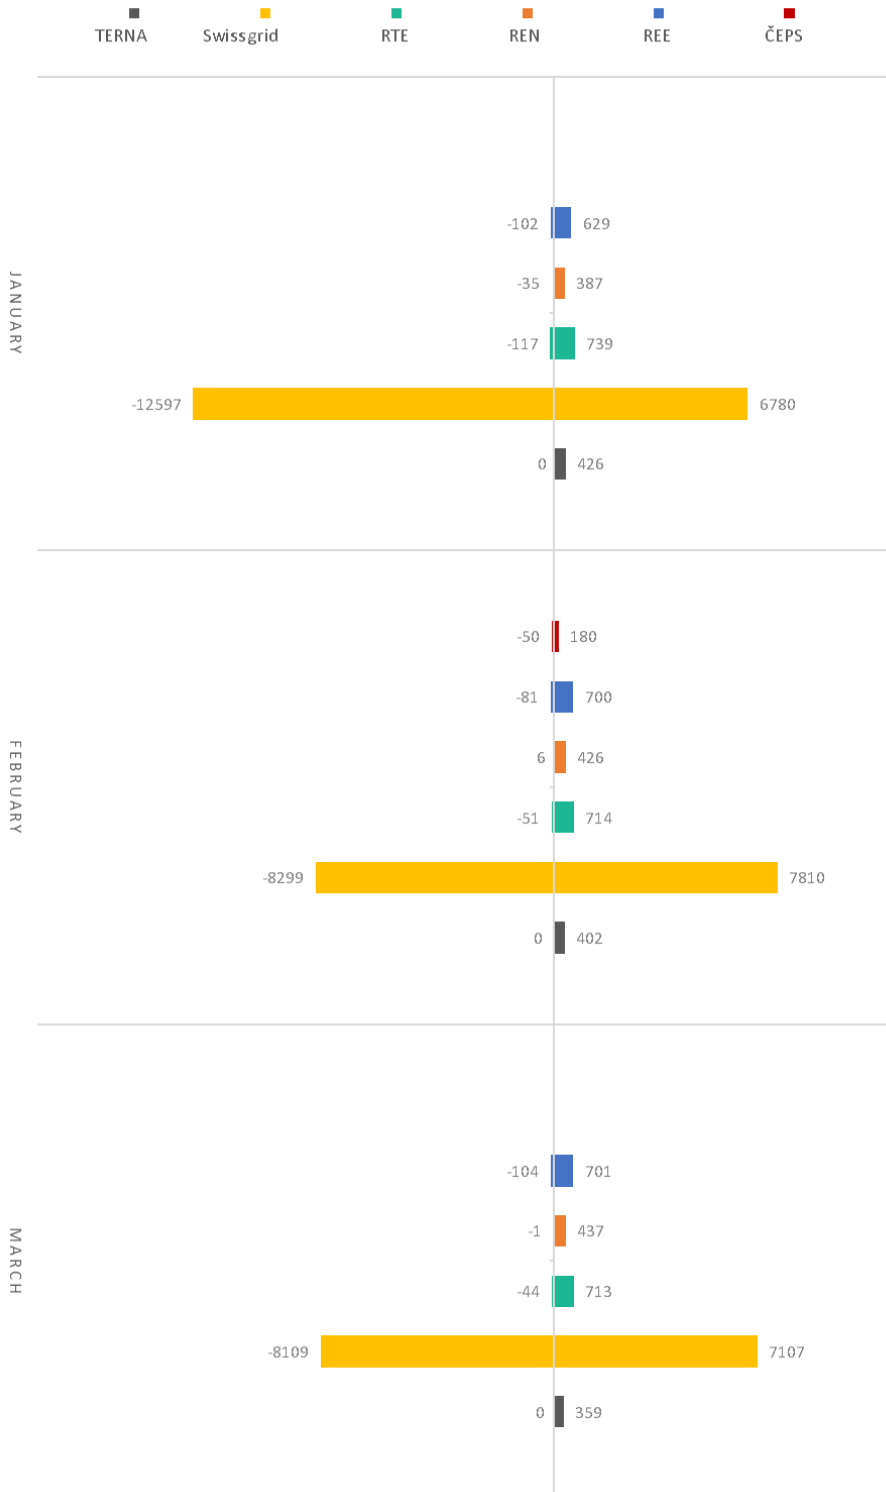


Figure 6: TERRE - VWAP of the 5% most expensive RR bids submitted [EUR/MWh] per country

4. Analysis of the price incidents

In accordance with Article 9(3) of the amended Balancing Pricing Methodology, all TSOs have to prepare a joint report whenever the CBMP reaches at least 50% of the minimum or maximum transitional price limit. Such a price incident is triggered whenever the threshold has been reached in at least one MTU (referred to as “event”). All events within one 15-min period are grouped into one incident if they cover the same uncongested area. For TERRE and MARI this equals one market-time unit (MTU). For PICASSO several events can take place within one 15-min incident period as the MTU equals 4 sec (i.e., an incident in PICASSO can be of duration from 4 sec to 15 min). All TSOs choose this approach for PICASSO as the bid structure and therefore the CMOL remain the same for the 15-min period.

4.1 Analysis of the aFRR pricing spikes

In total 118 price incidents occurred between 1 January and 31 March 2023 in the aFRR market, 33 in positive direction and 85 in negative direction. This reflects a stable development of incidents, no significant changes in the number can be observed over time since the go-live of the aFRR platform. Compared to the incidents reported for the first quarter of operation (Q3 2022), several observations can be made.

1. Majority of incidents occur in negative direction

Similar to the distribution of price incidents in Q4 2022, majority of the aFRR incidents in Q1 2023, i.e., 72 %, occurred in negative direction.

2. Increasing number of incidents for which Czech Republic forms the affected uncongested area

Over the first two quarters of platform operation, majority of incidents occurred with Austria forming the affected uncongested area or a combination of two or all three connected countries. Czech Republic was only affected as part of an uncongested area with Austria and/or Germany. This situation changed in Q1 2023, during which Czech Republic as single uncongested area triggered a price incident in 15 % of all cases (Figure 7). Over the observed period, Germany triggered the single country incident in 12 percent of cases, while Austria in 56 percent.

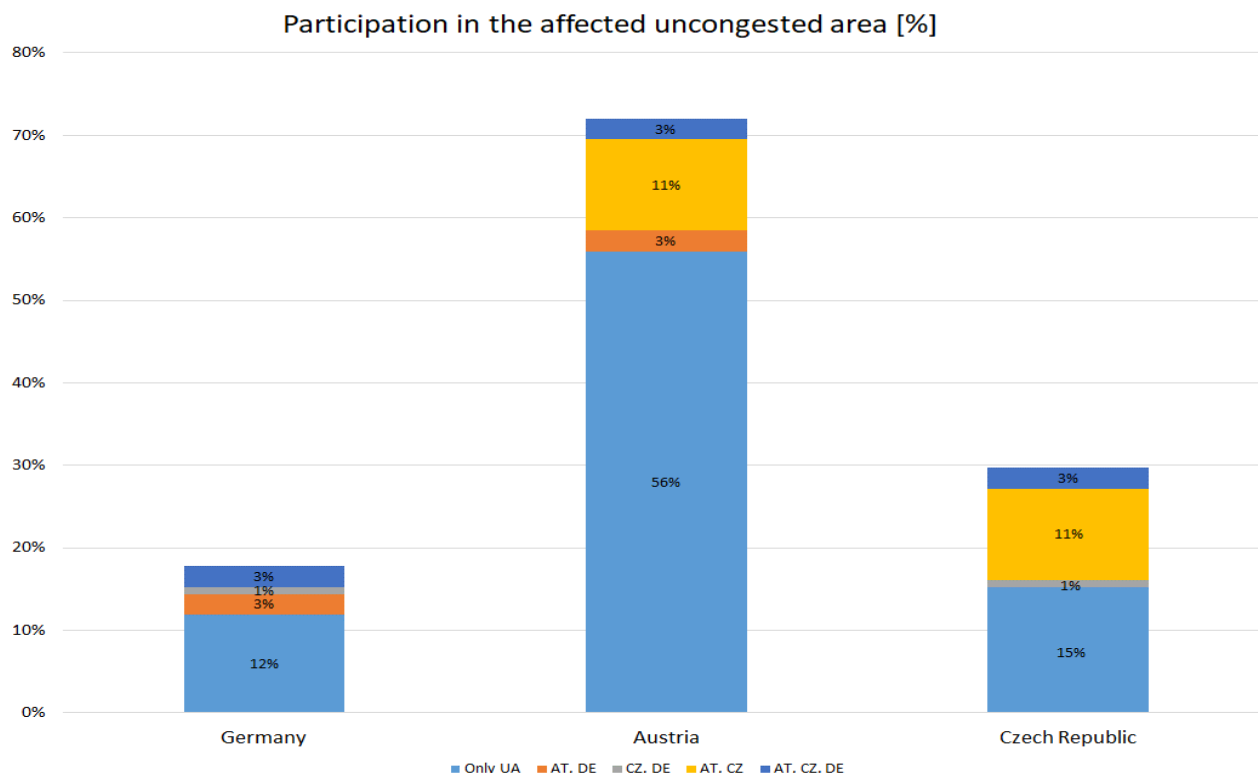


Figure 7: Country participation in the uncongested area affected by an aFRR price incident

3. Incidents are largely triggered at a certain CBMP below the 15 kEUR price cap

As already observed in Q3 and Q4 2022, majority of the price incidents occur at a CBMP below the temporary price cap of +/- 15 000 EUR/MWh. It has been noticeable that majority of the incidents during this period occurred at +/- 10 000 EUR/MWh, which might be explained as an aftermath of the previously applied sunshine rule in Austria. In Q1 2023 the same observation can be made for aFRR price incidents in positive direction, however, it is remarkable that this “threshold” moved towards 9 200 EUR/MWh for aFRR price incidents in negative direction (Figure 8 and 9). So far, no suitable explanation can be provided for this behavior.

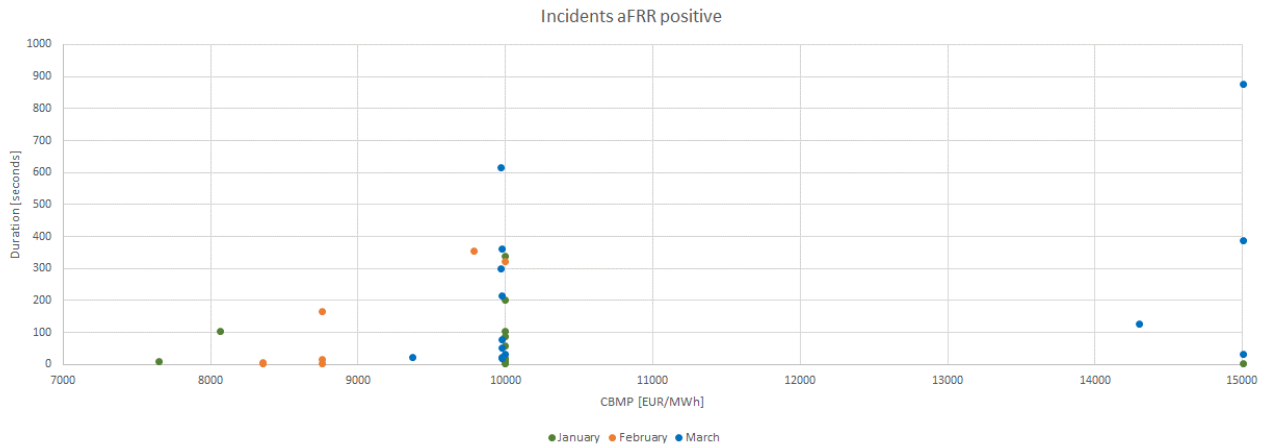


Figure 8: Duration and CBMP of aFRR positive price incidents

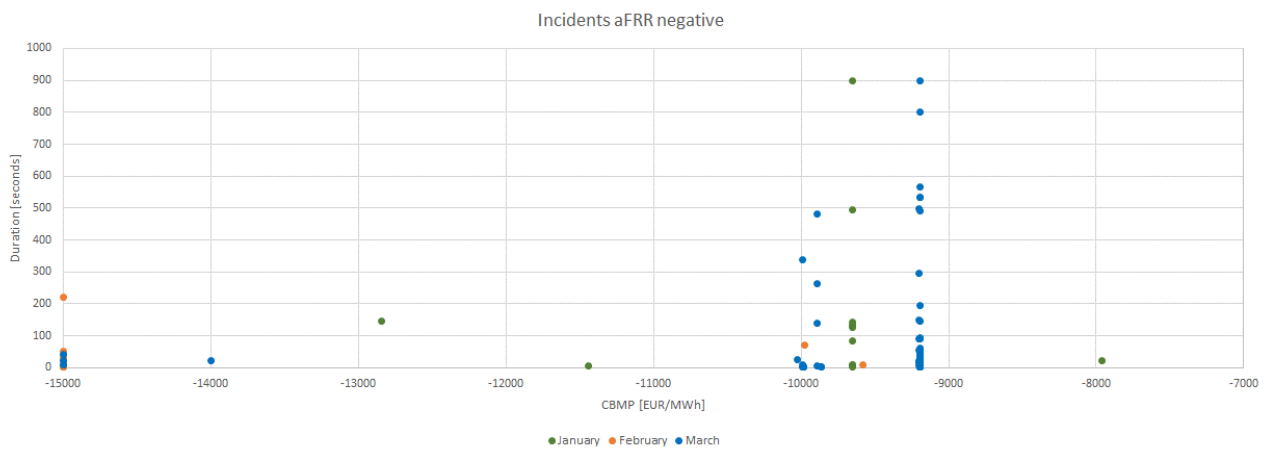


Figure 9: Duration and CBMP of aFRR negative price incidents

4. Overall market concentration levels decreased, yet with pivotal position of BSPs

Comparing the market concentration levels and pivotality of BSPs in Q4 2022 and Q1 2023 no major changes are noticeable. Figure 10 shows that overall market concentration levels remain high during price incidents, especially in positive direction. Looking at the market shares of the largest BSP in the affected uncongested areas during the price incidents shows that in 47 percent of all aFRR incidents the largest supplier had a market share of at least 25 percent and only in 11 percent of all incidents the largest supplier had a market share of 50 percent or more having a pivotal BSP in each price incident that occurred (Figure 11). This issue will probably not change with more TSOs joining the platforms as local BSP structure will not change and there will always be moments when local markets are isolated due to not available ATCs.

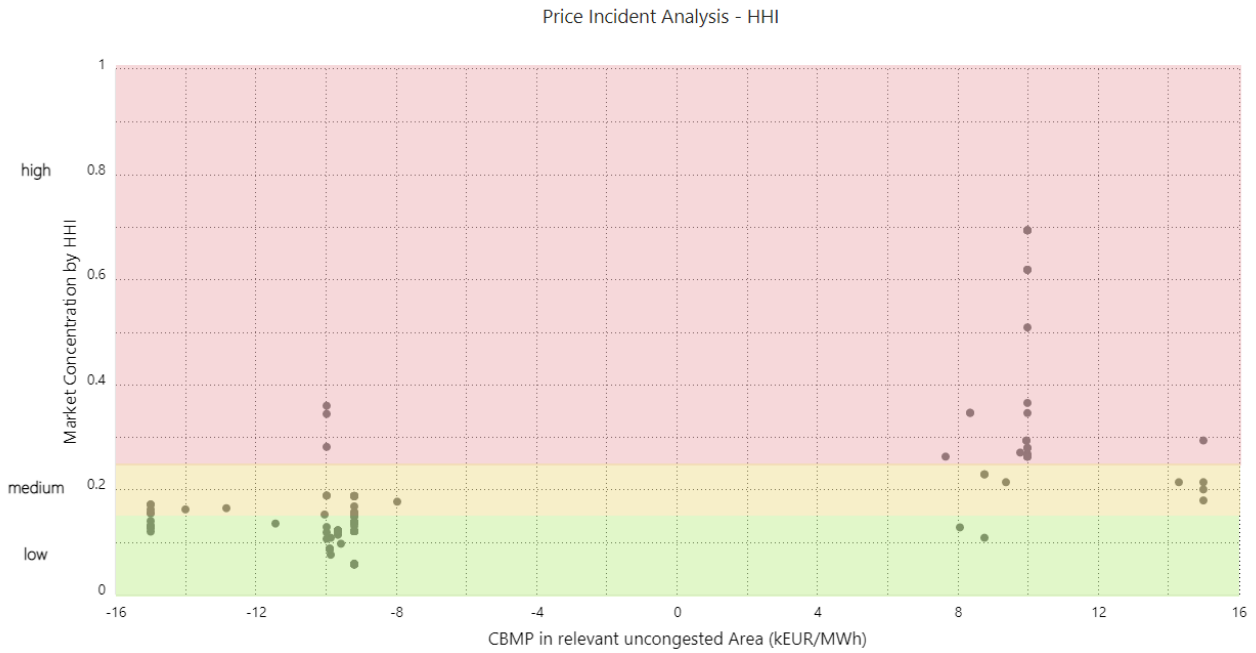


Figure 10: aFRR price incident analysis - HHI

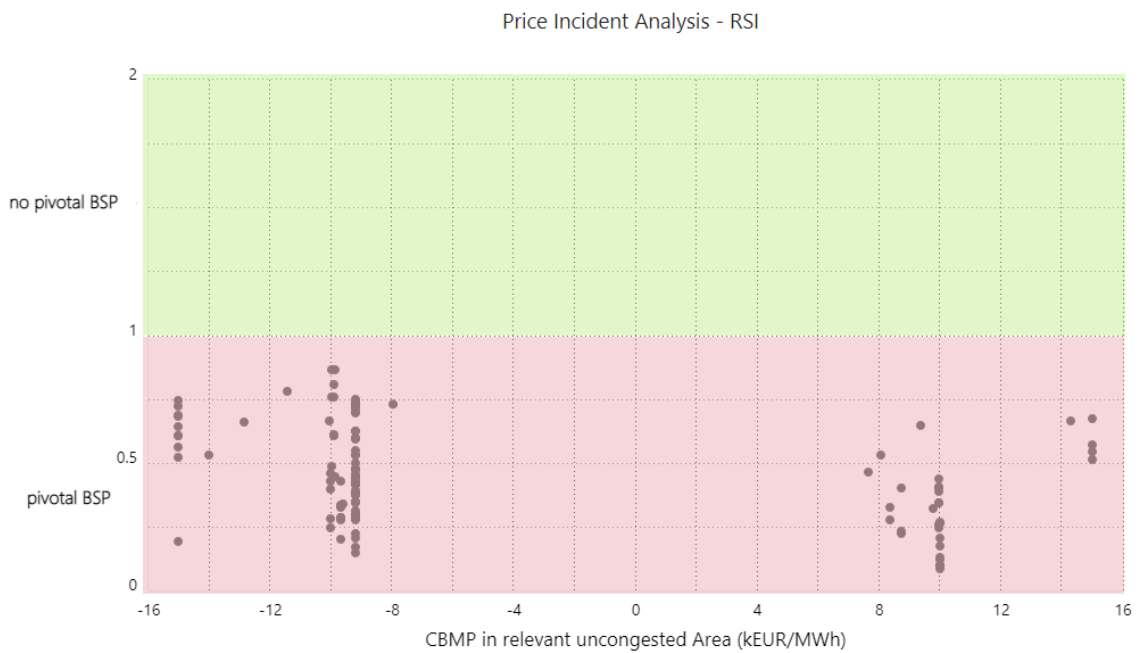


Figure 11: aFRR price incident analysis - RSI

4.2 Analysis of the mFRR pricing incidents

In Q1 2023, nine mFRR incidents occurred, one for scheduled activation in positive direction and the remaining eight for scheduled and direct activation in negative direction. All incidents occurred when no ATC was available leading to either Germany or Czech Republic forming solely the affected uncongested area (Figure 12). Looking at the market concentration it is lower compared to the concentration on the aFRR market and there have been two incidents at MARI in which the largest supplier was not pivotal to meet the submitted demand (Figure 13 and 14).

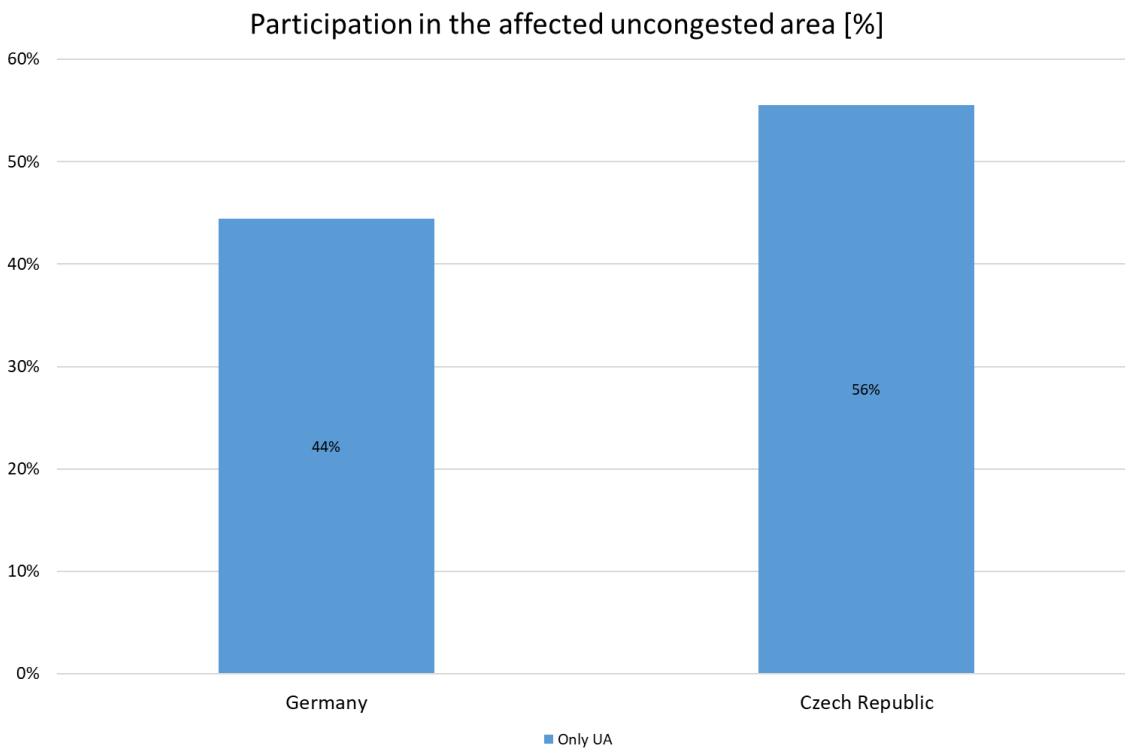


Figure 12: Country participation in the uncongested area affected by a mFRR price incident

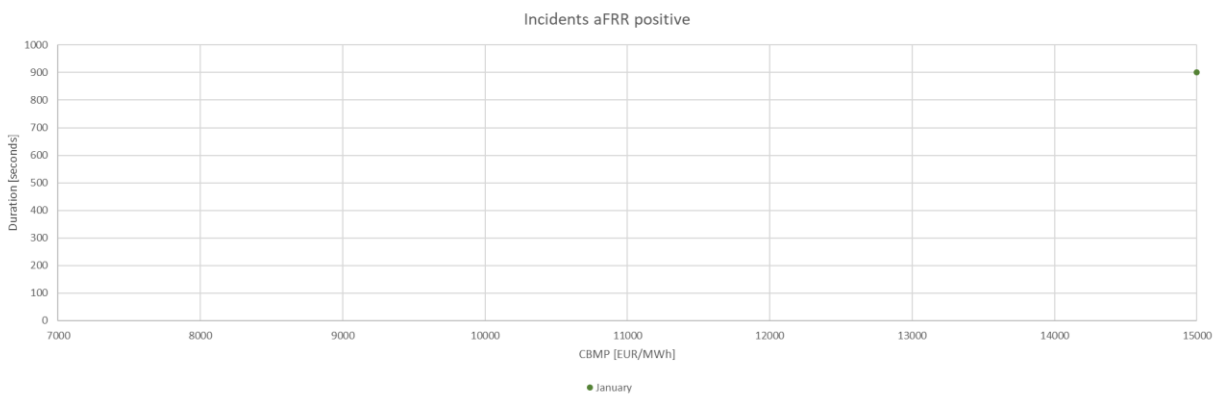


Figure 13: Duration and CBMP of mFRR positive price incidents

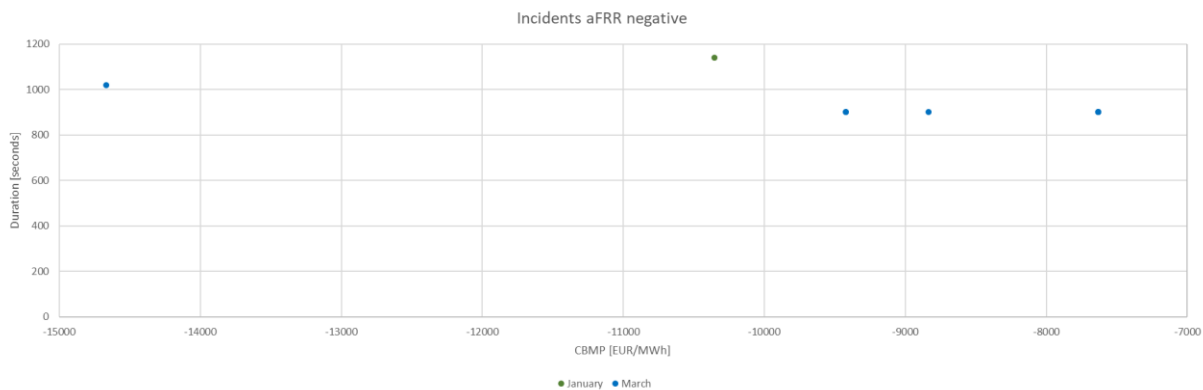


Figure 14: Duration and CBMP of mFRR negative price incidents

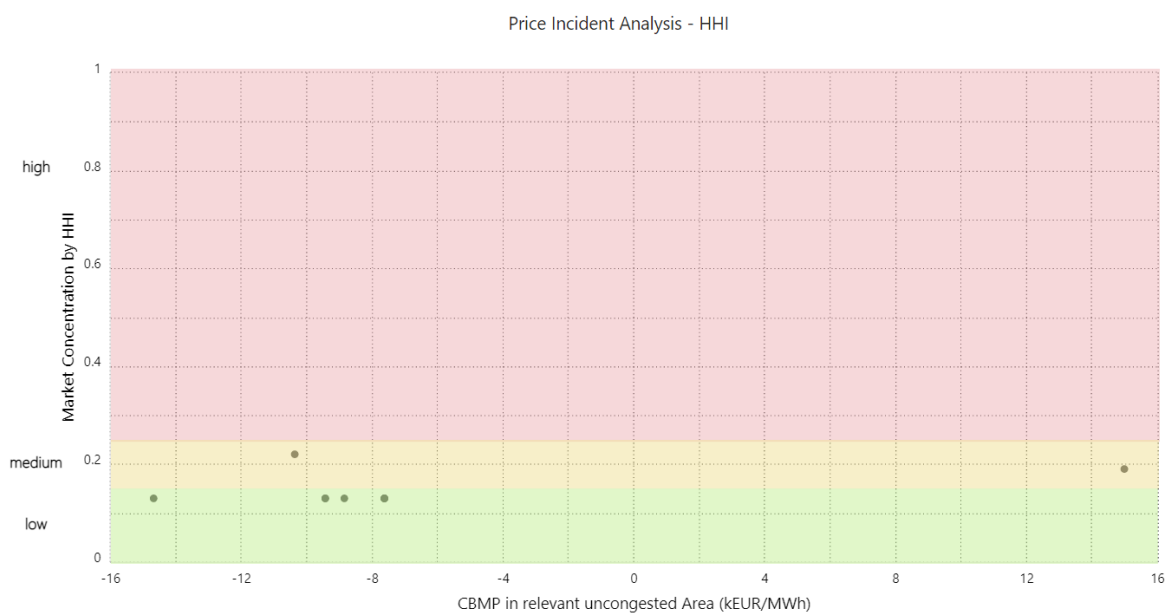


Figure 15: mFRR price incident analysis - HHI

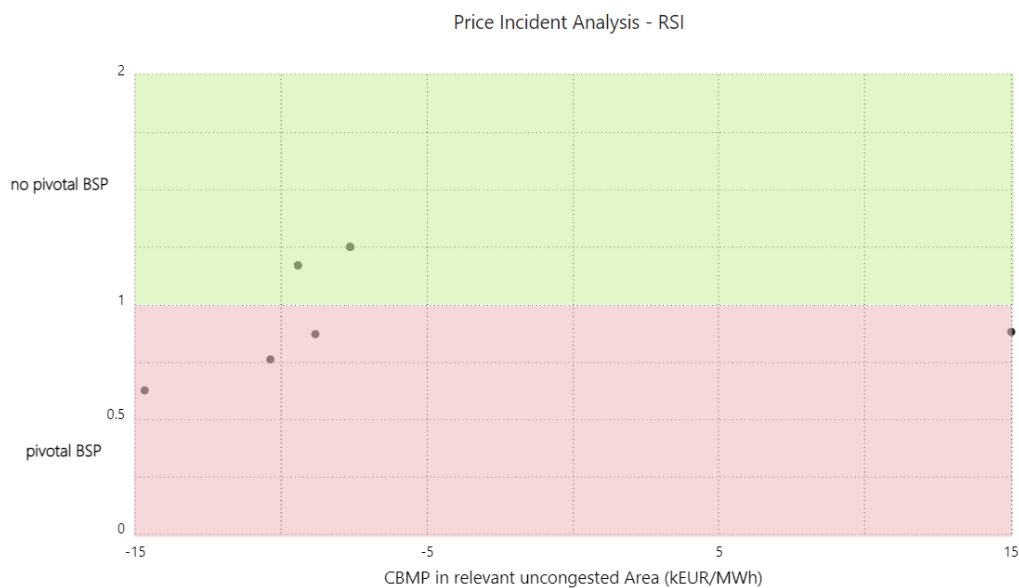


Figure 16: mFRR price incident analysis - RSI

4.3 Analysis of the RR pricing incidents

No RR incidents according to article 9(5) of the amended Balancing Pricing Methodology occurred in Q1 2023.

List of figures

FIGURE 1: PICASSO – AVERAGE USED AND AVAILABLE CROSS-ZONAL CAPACITY FOR THE EXCHANGE OF AFRR BETWEEN 1 JANUARY AND 31 MARCH 2023 [MW].....	6
FIGURE 2: MARI – AVERAGE USED AND AVAILABLE CROSS-ZONAL CAPACITY FOR THE EXCHANGE OF MFRR BETWEEN 1 JANUARY AND 31 MARCH 2023 [MW].....	7
FIGURE 3: TERRE– AVERAGE USED AND AVAILABLE CROSS-ZONAL CAPACITY FOR THE EXCHANGE OF RR BETWEEN 1 JANUARY AND 31 MARCH 2023 [MW].....	9
FIGURE 4: PICASSO - VWAP OF THE 5% MOST EXPENSIVE AFRR BIDS SUBMITTED [EUR/MWH] PER COUNTRY.....	15
FIGURE 5: MARI - VWAP OF THE 5% MOST EXPENSIVE MFRR BIDS SUBMITTED [EUR/MWH] PER COUNTRY.....	16
FIGURE 6: TERRE - VWAP OF THE 5% MOST EXPENSIVE RR BIDS SUBMITTED [EUR/MWH] PER COUNTRY.....	17
FIGURE 7: COUNTRY PARTICIPATION IN THE UNCONGESTED AREA AFFECTED BY AN AFRR PRICE INCIDENT.....	19
FIGURE 8: DURATION AND CBMP OF AFRR POSITIVE PRICE INCIDENTS.....	20
FIGURE 9: DURATION AND CBMP OF AFRR NEGATIVE PRICE INCIDENTS.....	20
FIGURE 10: AFRR PRICE INCIDENT ANALYSIS - HHI.....	21
FIGURE 11: AFRR PRICE INCIDENT ANALYSIS - RSI.....	21
FIGURE 12: COUNTRY PARTICIPATION IN THE UNCONGESTED AREA AFFECTED BY A MFRR PRICE INCIDENT.....	22
FIGURE 13: DURATION AND CBMP OF MFRR POSITIVE PRICE INCIDENTS.....	22
FIGURE 14: DURATION AND CBMP OF MFRR NEGATIVE PRICE INCIDENTS.....	23
FIGURE 15: MFRR PRICE INCIDENT ANALYSIS - HHI.....	23
FIGURE 16: MFRR PRICE INCIDENT ANALYSIS - RSI.....	24

List of tables

TABLE 1: PICASSO – MONTHLY AVERAGE VALUES OF USED AND AVAILABLE CROSS-ZONAL CAPACITY FOR THE EXCHANGE OF AFRR [MW].....	6
TABLE 2: MARI – MONTHLY AVERAGE VALUES OF USED AND AVAILABLE CROSS-ZONAL CAPACITY FOR THE EXCHANGE OF MFRR [MW].....	7
TABLE 3: TERRE – MONTHLY AVERAGE VALUES OF USED AND AVAILABLE CROSS-ZONAL CAPACITY FOR THE EXCHANGE OF RR [MW].....	8
TABLE 4: PICASSO – AVERAGE PERCENTAGE OF SUBMITTED BIDS OVER CERTAIN PRICE LIMITS.....	11
TABLE 5: PICASSO – AVERAGE PERCENTAGE OF SELECTED BIDS OVER CERTAIN PRICE LIMITS.....	11
TABLE 6: MARI – AVERAGE PERCENTAGE OF SUBMITTED BIDS OVER CERTAIN PRICE LIMITS.....	12
TABLE 7: MARI – AVERAGE PERCENTAGE OF SELECTED BIDS OVER CERTAIN PRICE LIMITS.....	12
TABLE 8: TERRE – AVERAGE PERCENTAGE OF SUBMITTED BIDS OVER CERTAIN PRICE LIMITS	13
TABLE 9: TERRE – AVERAGE PERCENTAGE OF SELECTED BIDS OVER CERTAIN PRICE LIMITS	13

Annex – Calculation formulas for the PIs

1. Monthly average values of used and available cross-zonal capacity for the exchange of balancing energy

Definition	Monthly average values per MTU to be calculated for each balancing energy platform per each BZ border in both directions. Each balancing energy platform needs to report four values per BZ border: the CZC initially available per border and per direction and the CZC used per border and per direction.
-------------------	---

Legal reference Article 9(4) of the amended pricing methodology

Time reference	Monthly average values per MTU
-----------------------	--------------------------------

Data source TERRE, MARI, PICASSO

The data will be collected directly from the platforms in a ready-for-reporting format.

Calculation	<p>Available CZC for BZ border_{ij} [MW] (one indicator per direction)</p> $= \frac{\sum_{MTU} \text{Volume of initial (import/export) CZC available on BZ border}_{ij} \text{ for RR/mFRR/aFRR}}{\text{Market Time Units per month}}$ <p>where BZ border_{ij} represents the border of BZ_i and BZ_j of all bidding zones connected to the RR/mFRR/aFRR platform</p> <p>Used CZC for BZ border_{ij} [MW] (one indicator per direction)</p> $= \frac{\sum_{MTU} \text{Volume of initial (import/export) CZC available on BZ border}_{ij} \text{ for RR/mFRR/aFRR}}{\text{Market Time Units per month}}$ $- \frac{\sum_{MTU} \text{Volume of residual (import/export) CZC available on BZ border}_{ij} \text{ for RR/mFRR/aFRR}}{\text{Market Time Units per month}}$ <p>where BZ border_{ij} represents the border of BZ_i and BZ_j of all bidding zones connected to the RR/mFRR/aFRR platform</p>
--------------------	---

2. Average percentage of submitted and activated standard balancing energy bids compared the upper (and lower) transitional price limit

Definition The average percentage of the submitted and selected standard balancing energy bids are calculated on a monthly basis. For each balancing energy platform 20 values are collected, 5 values (50%, 75%, 90%, 95% and 99%) in upward and respectively in downward direction for a) submitted and b) selected balancing energy bids.

Legal reference Article 9(4) of the amended pricing methodology

Time reference Monthly average values per MTU

Data source TERRE, MARI, PICASSO

The data will be collected directly from the platforms in a ready-for-reporting format.

Calculation **Submitted upward balancing energy bids with prices higher than x% of the upper price limit [%]**

$$= \frac{\sum_{MTU} \text{volume of submitted upward RR/mFRR/aFRR bids}_j \text{ higher than } x\%}{\sum_{MTU} \text{volume of all submitted upward RR/mFRR/aFRR bids}}$$

where bids_j represent all submitted upward RR/mFRR/aFRR bids with offered prices higher than p_j = 50%, 75%, 90%, 95% and 99% of the upper transitional price limit

Submitted downward balancing energy bids with prices lower than x% of the lower price limit [%]

$$= \frac{\sum_{MTU} \text{volume of submitted downward RR/mFRR/aFRR bids}_j \text{ lower than } x\%}{\sum_{MTU} \text{volume of all submitted downward RR/mFRR/aFRR bids}}$$

where bids_j represents all submitted downward RR/mFRR/aFRR bids with offered prices lower than p_j = 50%, 75%, 90%, 95% and 99% of the lower transitional price limit

Upward balancing energy with prices higher than x% of the upper price limit [%]

$$= \frac{\sum_{MTU} \text{volume of (activated) upward balancing energy RR/mFRR/aFRR with prices higher than } x\%}{\sum_{MTU} \text{volume of upward balancing energy RR/mFRR/aFRR}}$$

where x% refers to 50%, 75%, 90%, 95% and 99% of the upper transitional price limit

Downward balancing energy with prices lower than x% of the lower price limit [%]

$$= \frac{\sum_{MTU} \text{volume of (activated) downward balancing energy RR/mFRR/aFRR with prices lower than } x\%}{\sum_{MTU} \text{volume of downward balancing energy RR/mFRR/aFRR}}$$

where x% refers to 50%, 75%, 90%, 95% and 99% of the lower transitional price limit

3. Volume weighted average price of the last and most expensive balancing energy bids

Definition The VWAP of the last 5% of the submitted bids per platform, per direction and per participating TSO is calculated on a monthly basis. Each balancing platform needs to report two values per connected TSO, one for upward and one for downward direction.

Legal reference Article 9(4) of the amended pricing methodology

Time reference Monthly

Data source TERRE, MARI, PICASSO

The data will be collected directly from the platforms in a ready-for-reporting format.

Calculation **VWAP of the last most expensive 5% of the upward balancing energy bids submitted by TSO_i [EUR/MWh]**

$$= \frac{\sum_j \text{volume of most expensive 5\% submitted RR/mFRR/aFRR bid}_j \times \text{price of submitted RR/mFRR/aFRR bid}_j}{\sum_j \text{volume of most expensive 5\% submitted RR/mFRR/aFRR bid}_j}$$

where $i=1,2,\dots$ represents the TSOs connected to the RR/mFRR/aFRR platform and where j represents the last 5% of submitted upward balancing energy bids by TSO_i

VWAP of the last 5% of the downward balancing energy bids submitted by TSO_i [EUR/MWh]

$$= \frac{\sum_j \text{volume of most expensive 5\% submitted RR/mFRR/aFRR bid}_j \times \text{price of submitted RR/mFRR/aFRR bid}_j}{\sum_j \text{volume of most expensive 5\% submitted RR/mFRR/aFRR bid}_j}$$

where $i=1,2,\dots$ represents the TSOs connected to the RR/mFRR/aFRR platform and where j represents the last 5% of submitted downward balancing energy bids by TSO_i